
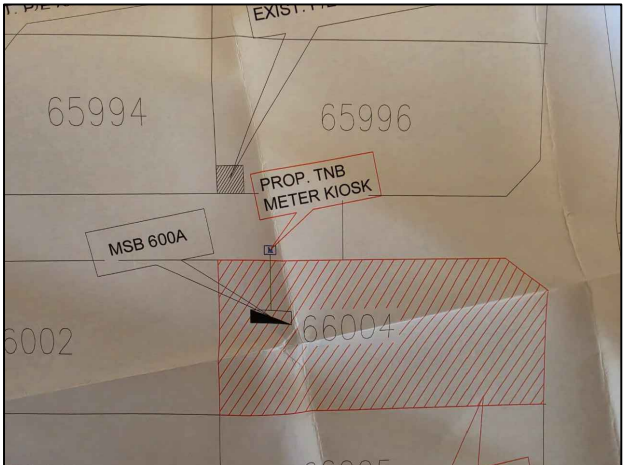


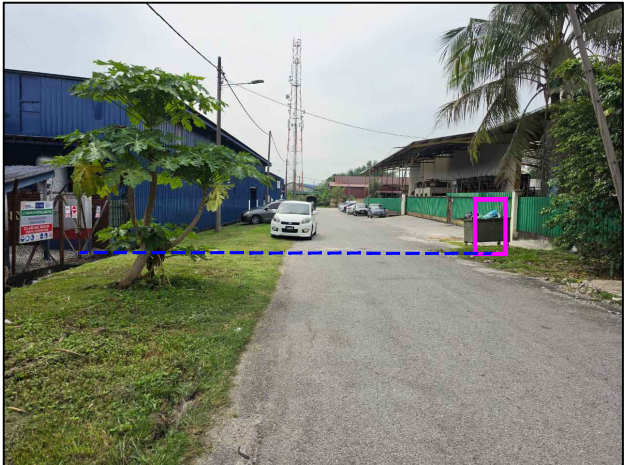

Petunjuk: (Sediada)
Peti Pembekal 1600A

Petunjuk: (Cadangan)
Kabel B/Tanah VR 185mmp x 4 teras xlpe alum (1kV)
Corrugated 150mmp Open Cut Tar
Meter Kiosk

ALL RIGHTS RESERVED
LUKISAN INI TIDAK BOLEH DIUBAHSAUAI
TANPA KEBENARAN DARI JURUTERA
TENAGA NASIONAL BERHAD

Kawasan	LALUAN KILANG	Daerah	IPOH	
No. Fail :	12000167119			
QUALITY LATEX				
Pindaan	Dilukis :	SHAKIR	Diluluskan :	AZIMI
	Disemak :	ZAINI	Tarikh :	01/08/26
	No. Lukisan :			