


PELAN 11KV



PE TUNJUK

- CA) KABEL 3C 150MMP XLPE 11KV
- KA) KABEL 3C 185MMP PILC 11KV
- CAL JOINT PIT

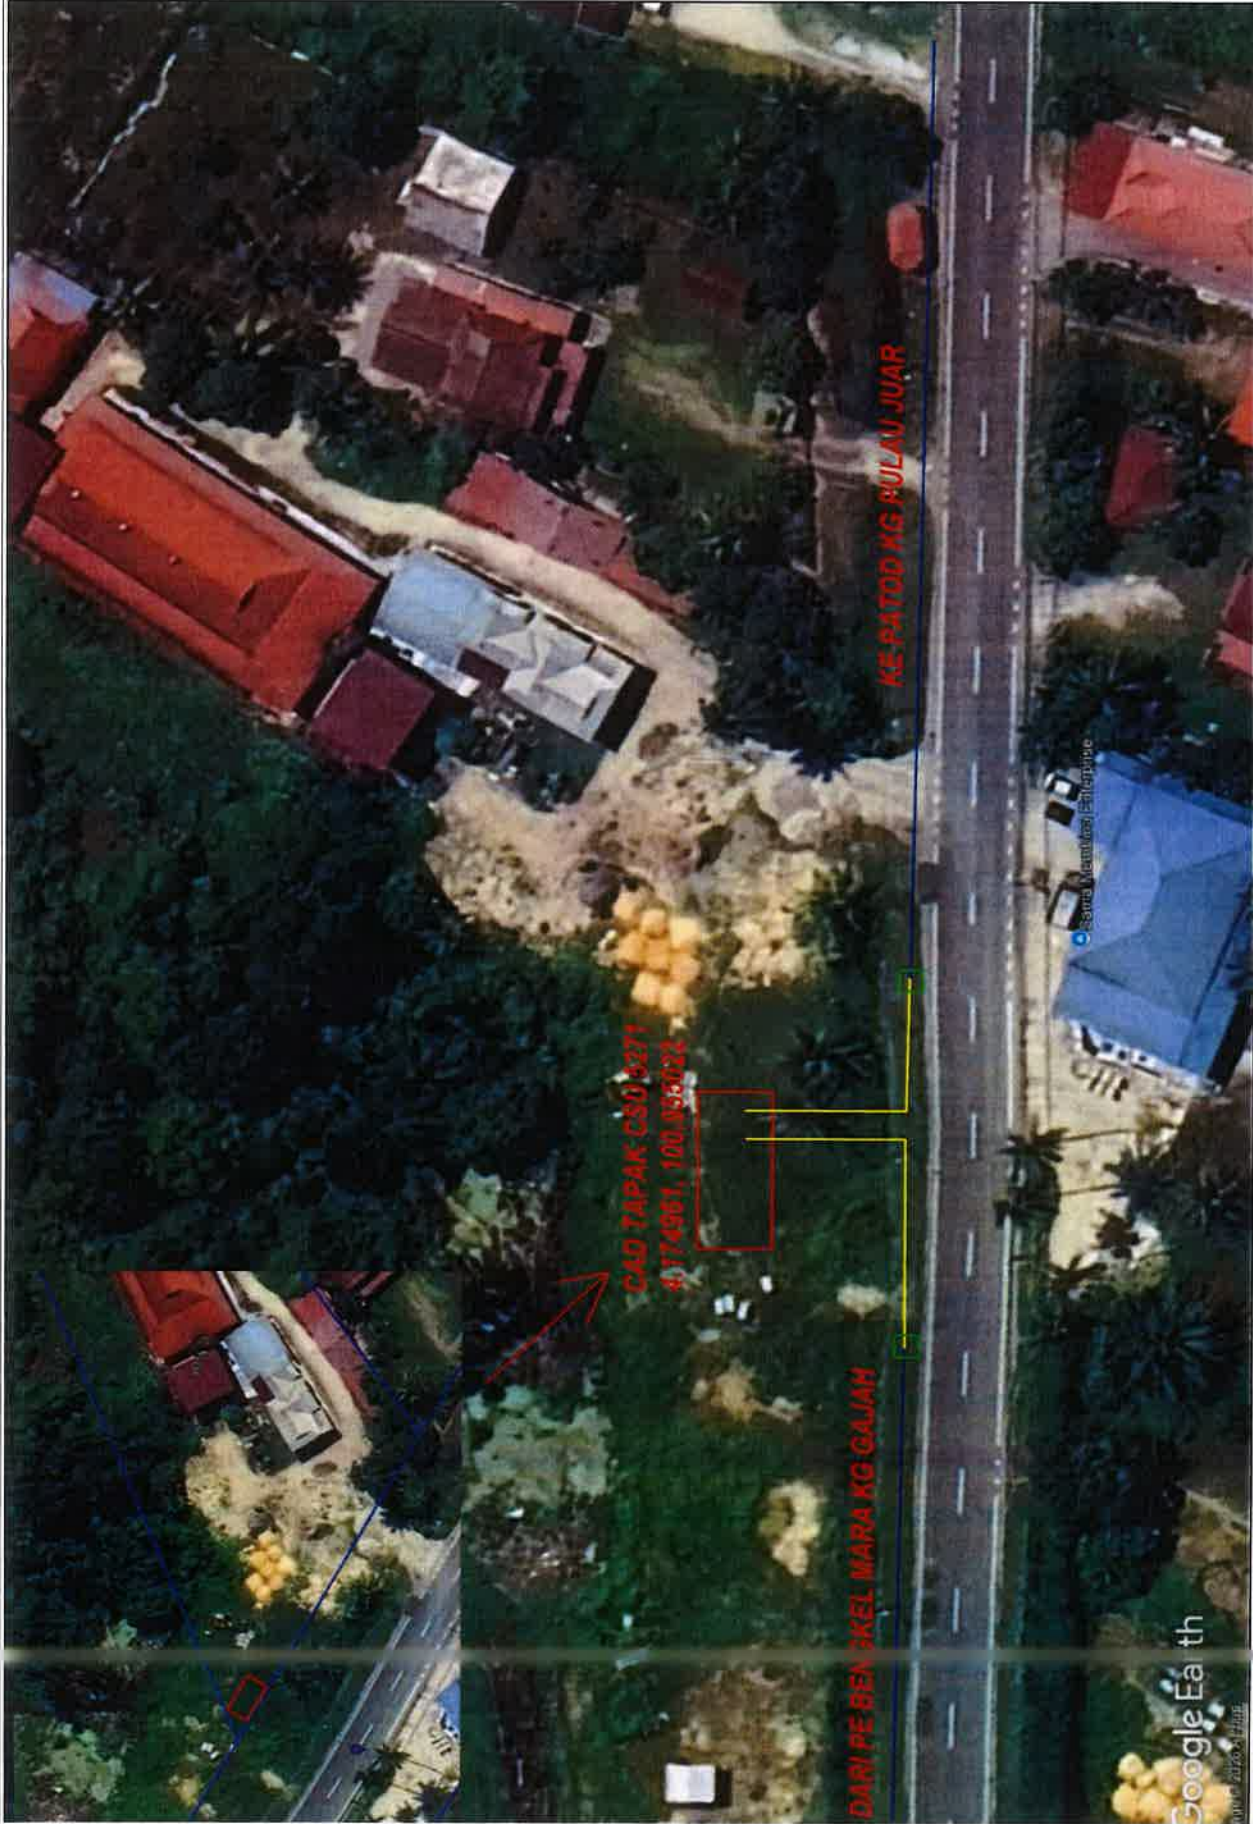

TENAGA NASIONAL

Negeri : PERAK | Subzone : SERI MANJUR
 No Fail : D-TEL-526-5271

MSVT- MEMBUJUKAN PENCANGKAP BARU DI KAWASAN KG RUI JUAR BAGI MENGATASI MASALAH LOW VOLTAGE

NO. FAIL :

KELUARAN PERITAMA	NO. DOKUMEN
NO. DOKUMEN	NO. DOKUMEN
NO. DOKUMEN	NO. DOKUMEN
NO. DOKUMEN	NO. DOKUMEN

Google Earth

PELAN 1KV



NEGERI: PERAK SUBZONE: SERI MANJUNJ
 NO. FAIL: D-TEL-526-5271

PELUSAN PERUMAH
 SIAKAP - PTD BAKAP
 DAWAT: SERI FARHAN
 DAWAT: SERI FARHAN
 DAWAT: SERI FARHAN
 DAWAT: SERI FARHAN

PE TUNJUK
 TIA VG SEDIADA
 KA 3EL 3C 185MMP 1KV



MSVT - MEMULJUKAN PENGANGKAP BARU DI KAWASAN KG RULU
 JUAR BAGI MENGATASI MASALAH LOW VOLTAGE

NO. FAIL :