

TECHNICAL PROPOSAL FOR VO TNB HDD

SITE NAME/ ID: KG SG PETAI/4306R

v00



SURVEY DATE	07-12-2025		
SITE NAME	KG SG PETAI		
MODEL SITE	60m 3 Legged Tower	SITE ID	4306R
STRUCTURE OWNER	CelcomDigi	PMSHIP:	1 ST CelcomDigi
ADDRESS	Lot 6369 Kampung Batu 9, 34850 Taiping, Perak		
LATITUDE NE	N 4.74756°	LONGITUDE NE	E 100.71897°
FAR END SITE	4343B Bukit Gantang RCC	AZIMUTH	46°
LATITUDE FE	N 4.776938°	LONGITUDE FE	E 100.750485°
DATE SUBMITTED	08/12/2025	REV DATE SUBMIT	
SURVEYED BY	VADI @ 0123929344	REGION	NORTHERN
SITE ACCESS	24/7 OR OFFICE HOURS	OSA REQUIREMENT GUIDELINE	MEET OR NOT


CHECK & APPROVED:

NAME				
DEPARTMENT	RADIO REGIONAL PLANNER	ACCESS TRANSMISSION PLANNER	SERVICE OPERATION	POWER
DATE				

SITE NAME/ID: KG SG PETAI /4306R

REVISION HISTORY

REVISION NO	DESCRIPTION
v00	
v01	

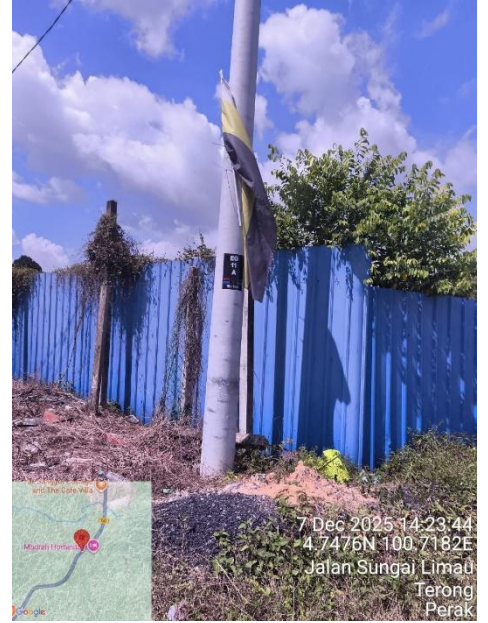


PROPOSED TO TAPPING AT IPC CONNECTOR WITH ABC 25MM CABLE 20MTR WITH 1 NO'S BLACK BOX



PROPOSED TO CUTTING PREMIX & LAY UG CABLE WITH MAKE GOOD



PROPOSED TO INSTALL UG POWER CABLE XLPE 25MM 180MTR

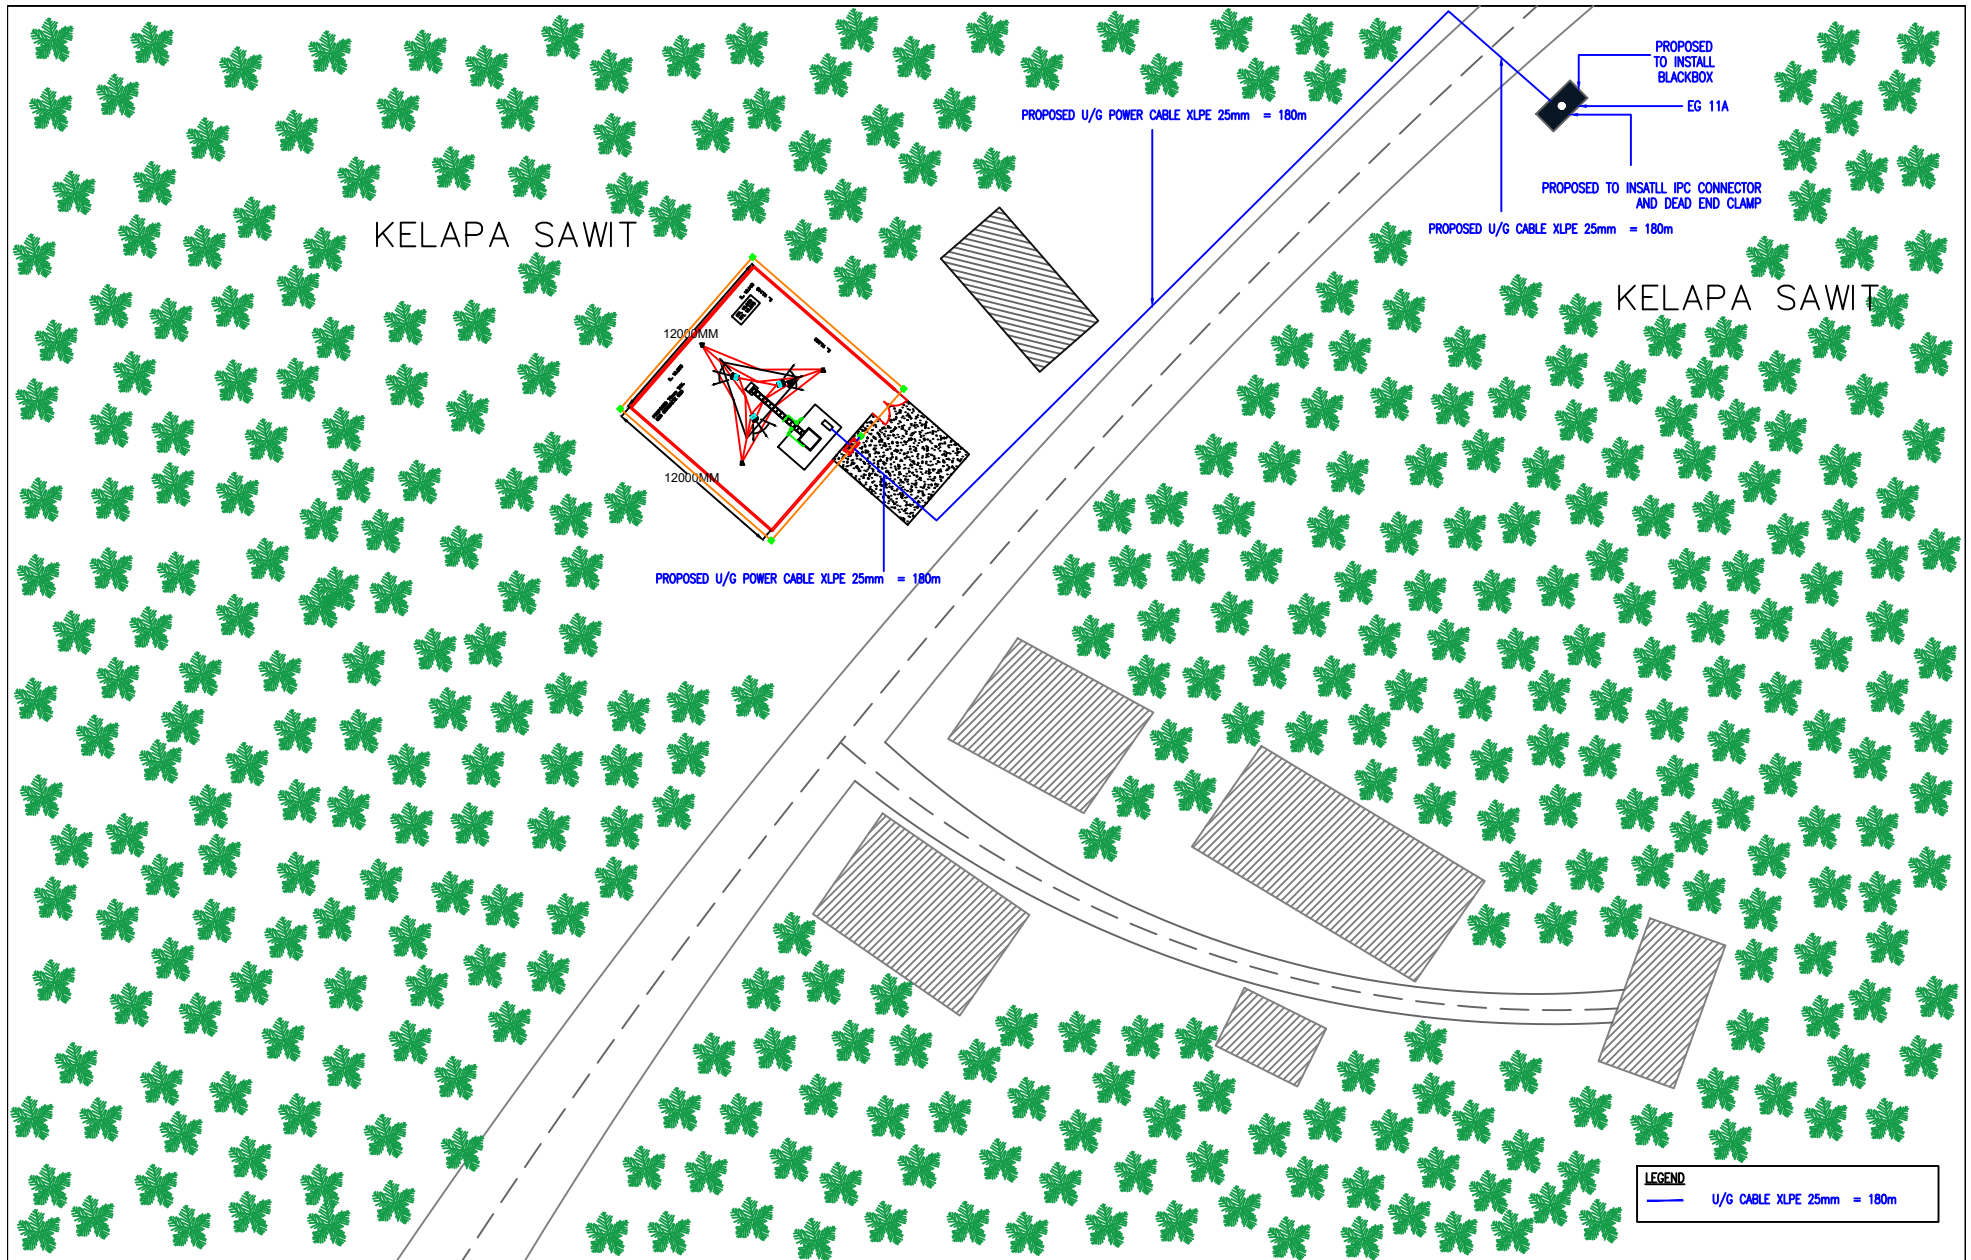

NERA	REVISION NO:	0	STATION NAME: FOREST CITY INTERNATIONAL SCHOOL, GELANG PATAH, JOHOR	SCALE:	NTS	UNIT:	mm	PAPER SIZE:	A4	
	SURVEY DATE:	12/12/2025	TITLE: GROUNDING ROUTING VIEW	DATE:	12/12/2025	STATE:		PERAK		
	DRAWN BY:	VADIVALAGAN	CONTENTS:	SITE LRD:	KG.SG.PETAL_4306R	REGION:		NORTHERN		
	PREPARED BY:	BEST CELL		DRAWING NO:	KG.SG.PETAL_4306R_RT_06					