


PELAN TAPAK

CRUSHER RUN





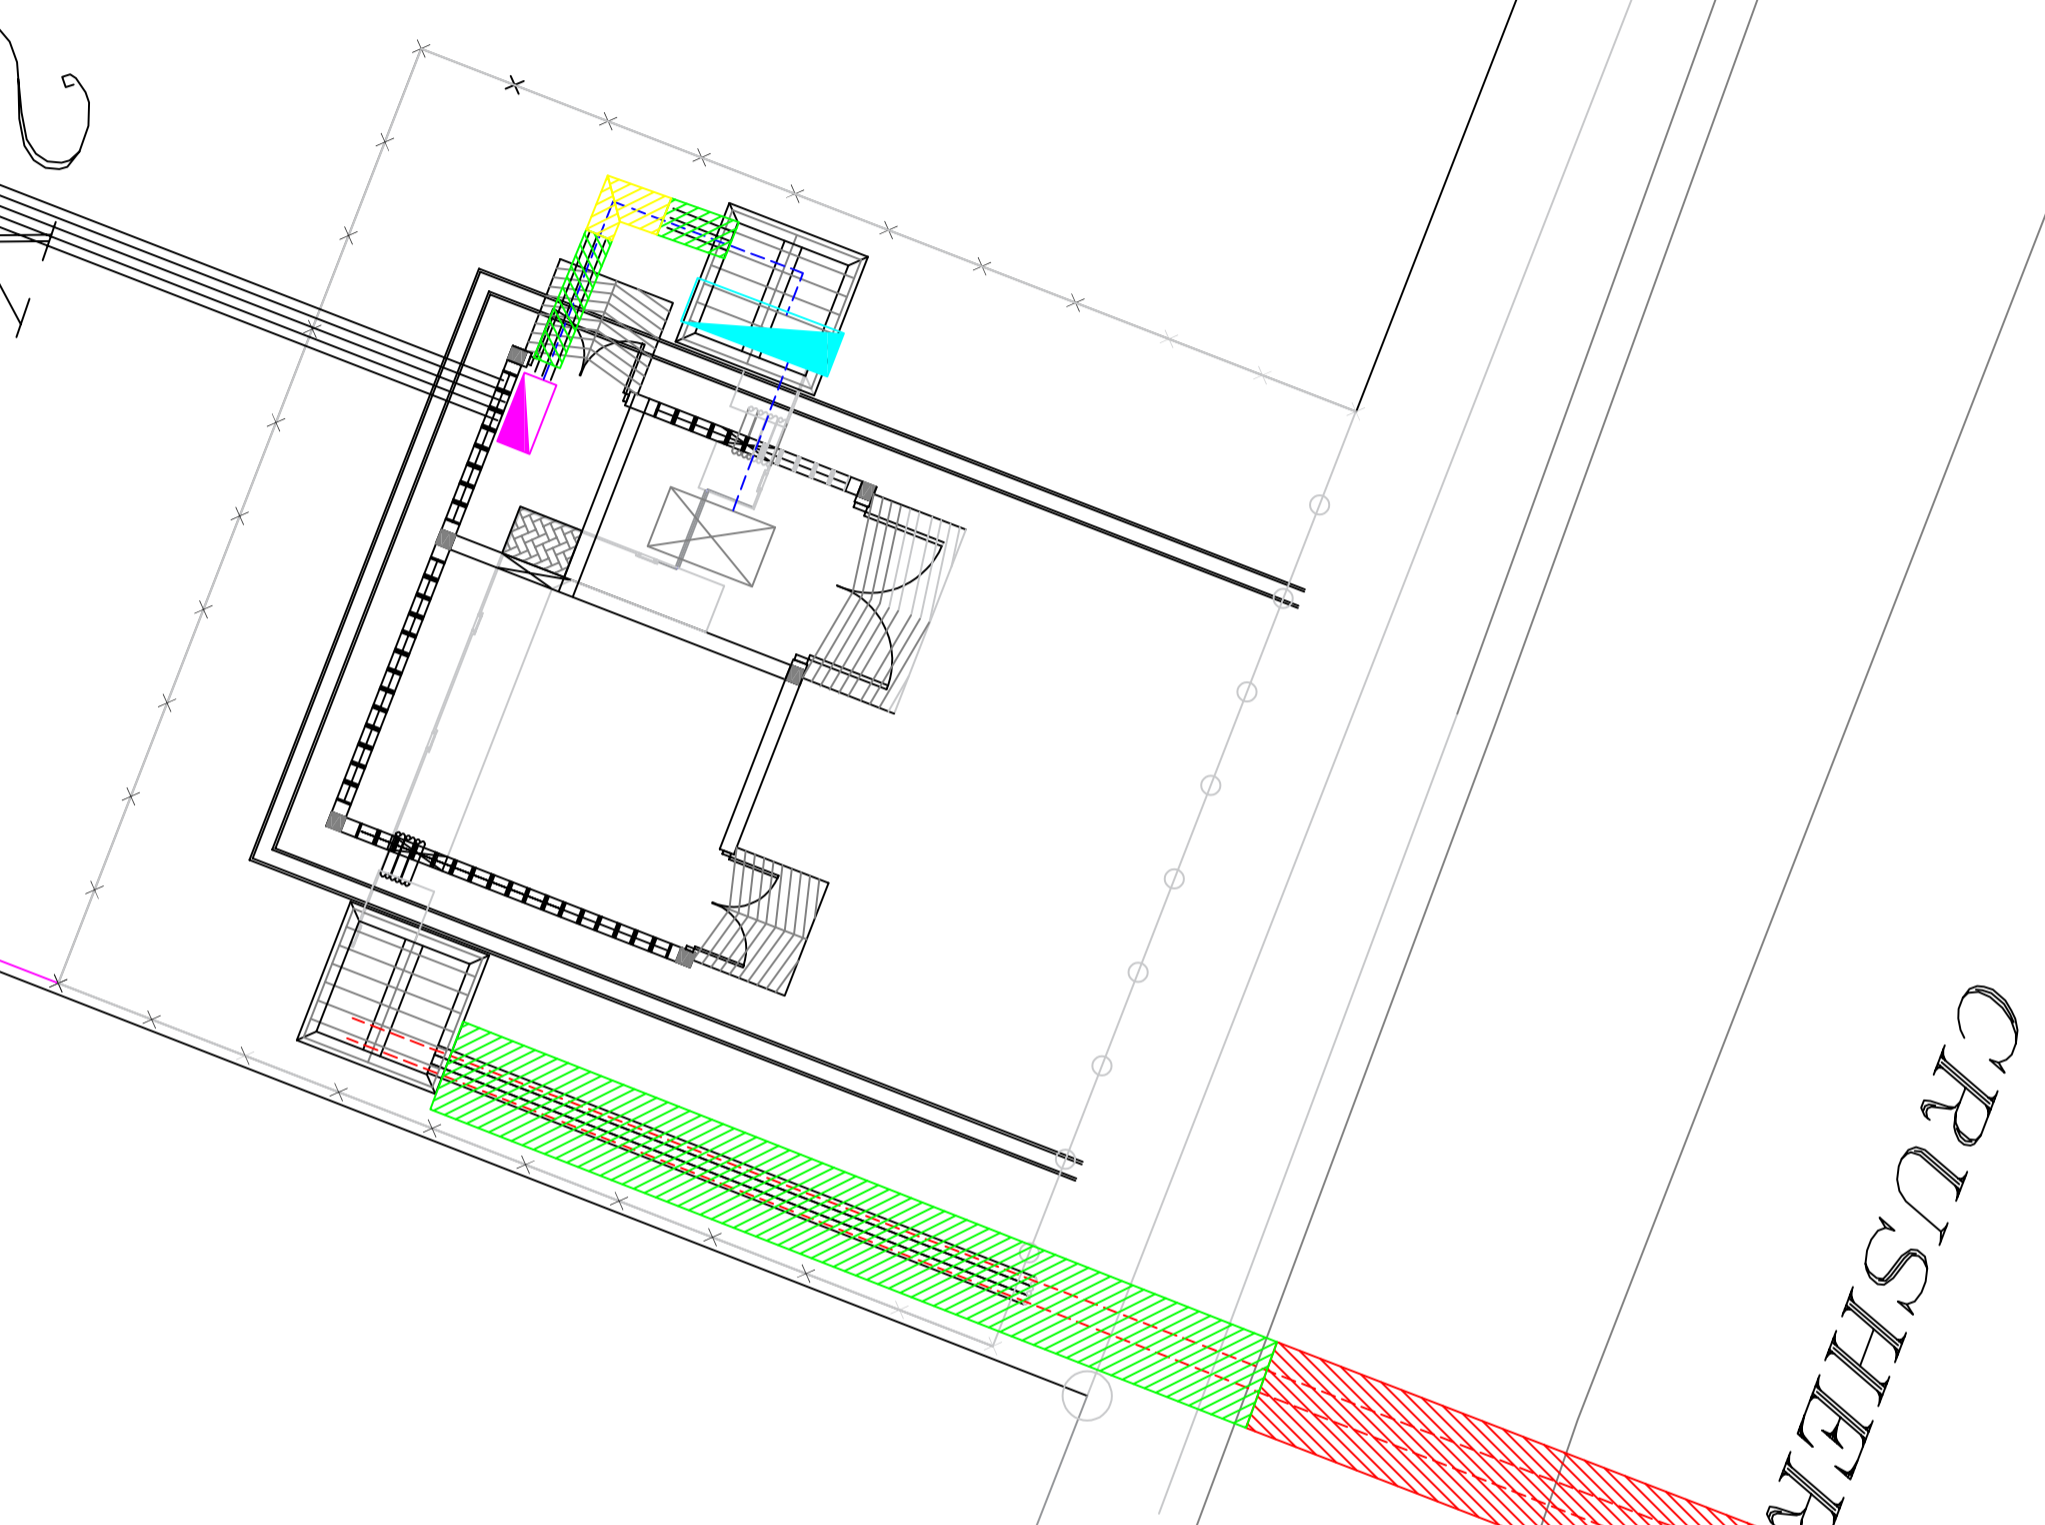

TH DRAIN
8.959

Ke p/e UNI CARBON




Ke p/e PDT MLC Trading (C20-1813)



Cadangan

-  Kabel B/Tanah KVT 240mmp x 3 teras xIpe alum (11kV)
-  Kabel B/Tanah KVT 7X500mmp x 1 teras PVC/PVC Cu (1kV)
-  Sambungan terus
-  Corrugated 150MMP
-  P/Pembekal 1600A
-  Open Cut

Petunjuk:

-  Kabel B/Tanah KVT 240mmp x 3 teras xIpe alum (11kV)
-  Paip PVC Class B
-  Meter Kiosk

Sediada



TENAGA NASIONAL BERHAD
Kawasan: Daerah
No. Fail: D-TGR-C24-1930

CADANGAN TAMBAHAN BEKALAN ELEKTRIK DARI 100A KE 1200A BAGI SEBUAH KILANG SEDIAADA DIATAS LOT 15579, JALAN KUALA KANGSAR, KANTHAN, PERAK DARUL RIDZUAN UNTUK TETUAN OIWAH ASSET SDN.BHD

Pindaan	Dilukis : ALLAS	Diluluskan : RAJA HANI
	Disemak : SHUHAILMI	Tarikh : 28/02/2024
	No. Lukisan :	C/POHPT/PAK/TGR 1930

ALL RIGHTS RESERVED
LUKISAN INI TIDAK BOLEH DUBAHASUI
TANPA KEBENARAN DARI JURUTERA
TEMAGA NASIONAL BERHAD