

CONNECTION TO PIPE EXISTING AT SHUT DOWN/POTONG TEE  
(KOORDINAT : 5.132480, 103.247169 )

PROPOSED MAIN PIPE  
250mm Ø M.S

100mm BULK METER FOR HYDRANT

PROPOSED NEW PIPE  
150mm Ø M.S PIPE

50mm Ø BULK METER FOR DOMESTIC



CONNECTION TO PIPE EXISTING AT SHUT DOWN/POTONG TEE  
(KOORDINAT : 5.131931, 103.247380 )

EXISTING MAIN PIPE  
500mm M.S

EXISTING MAIN PIPE  
200mm A.C

STORAGE TANK  
HDPE TANK 1755(D) x 2820(H)  
C/W 750mm x 750mm MANHOLE & COVER,  
50Ø INCOMING PIPE, 25Ø WARNING PIPE PIPE,  
250Ø VENT PIPE, 80Ø SCOUR & OVERFLOW PIPE  
S/S ELECTRODE, LEVEL INDICATOR  
450mm(W) INTERNAL ALUM. & EXTERNAL M.T CAT LADDER  
NOMINAL CAPACITY : 1200 GALS EACH

PAIP SEDIADA BERDEKATAN GARISAN PUTIH TEPI JALAN

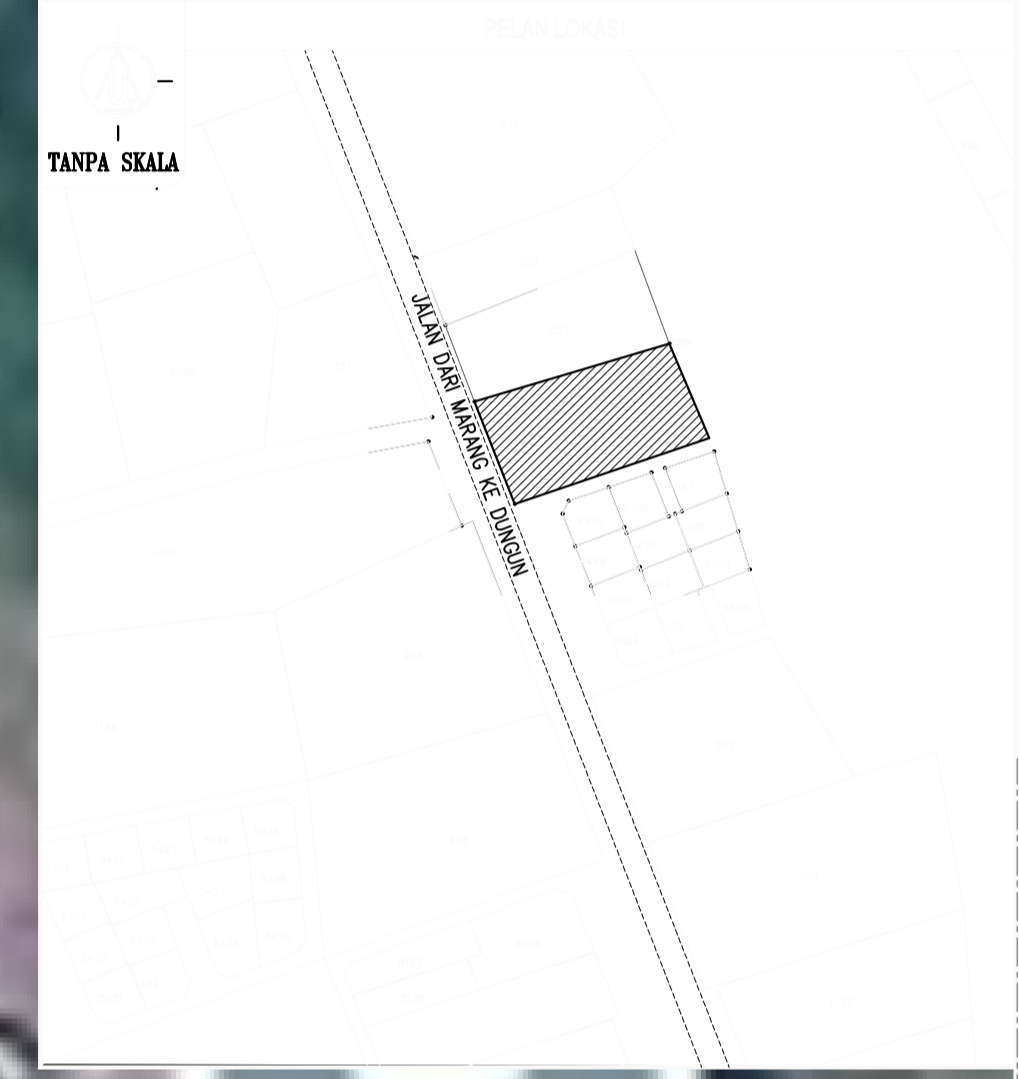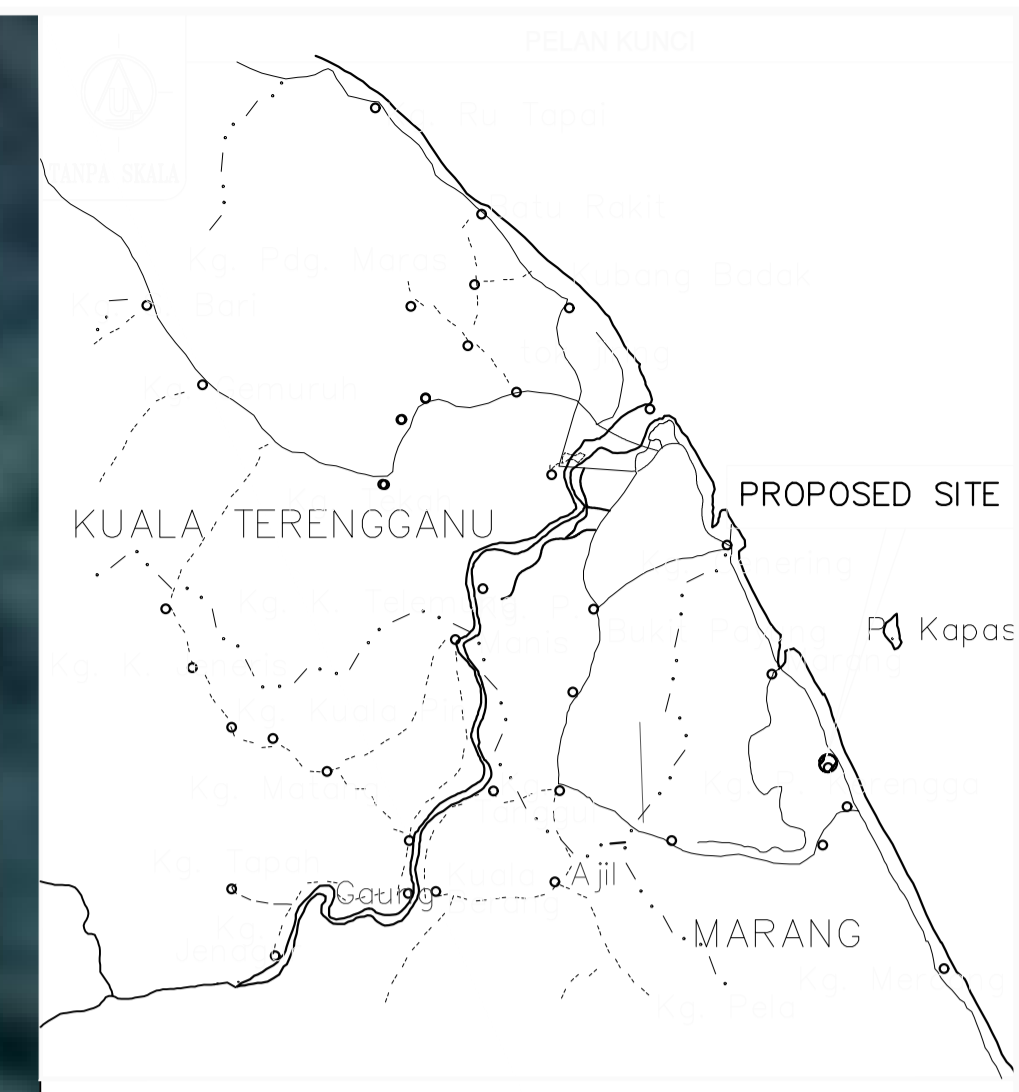

LEGEND :

PROPOSED 150mm Ø MS PIPE	
PROPOSED 250mm Ø M.S	
PROPOSED 50mm Ø STAINLESS STEEL PIPE	
EXISTING MAIN PIPE 250mm UPVC	
EXISTING MAIN PIPE 200mm A.C	
EXISTING MAIN PIPE 500mm M.S	
S-BEND	
BULK METER	
FIRE HYDRANT	
NODES	

CADANGAN MEMBINA DAN MENYIAPKAN SEBUAH STESAN MINYAK DAN SATU UNIT KEDAI SERBANEKA 1 TINGKAT JENIS KEKAL DI ATAS LOT PT 254 (GM 4268), KAMPUNG PULAU KERENGA, MUKIM PULAU KERENGA, DAERAH MARANG, TERENGGANU DARUL IMAN.

Saya memperakui bahawa 'detail-detail' dalam plan-pelan ini untuk projek yang terdapat di atas, adalah mematu kehendak-kehendak Undang-undang keajaib Bangunan 1984 dan saya setuju untuk menerima tanggungjawab penuh yang sewajarnya.

**AIS CONSULTANTS**  
2186-K, Tingkat 1,  
Kompleks Permodalan Harmoni,  
Jalan Engka Sari, Belas Baru,  
25000 Kuala Terengganu D.I.  
Tel : 09-6310528 Fax : 09-6310529

WATER RETICULATION LAY-OUT PLAN