








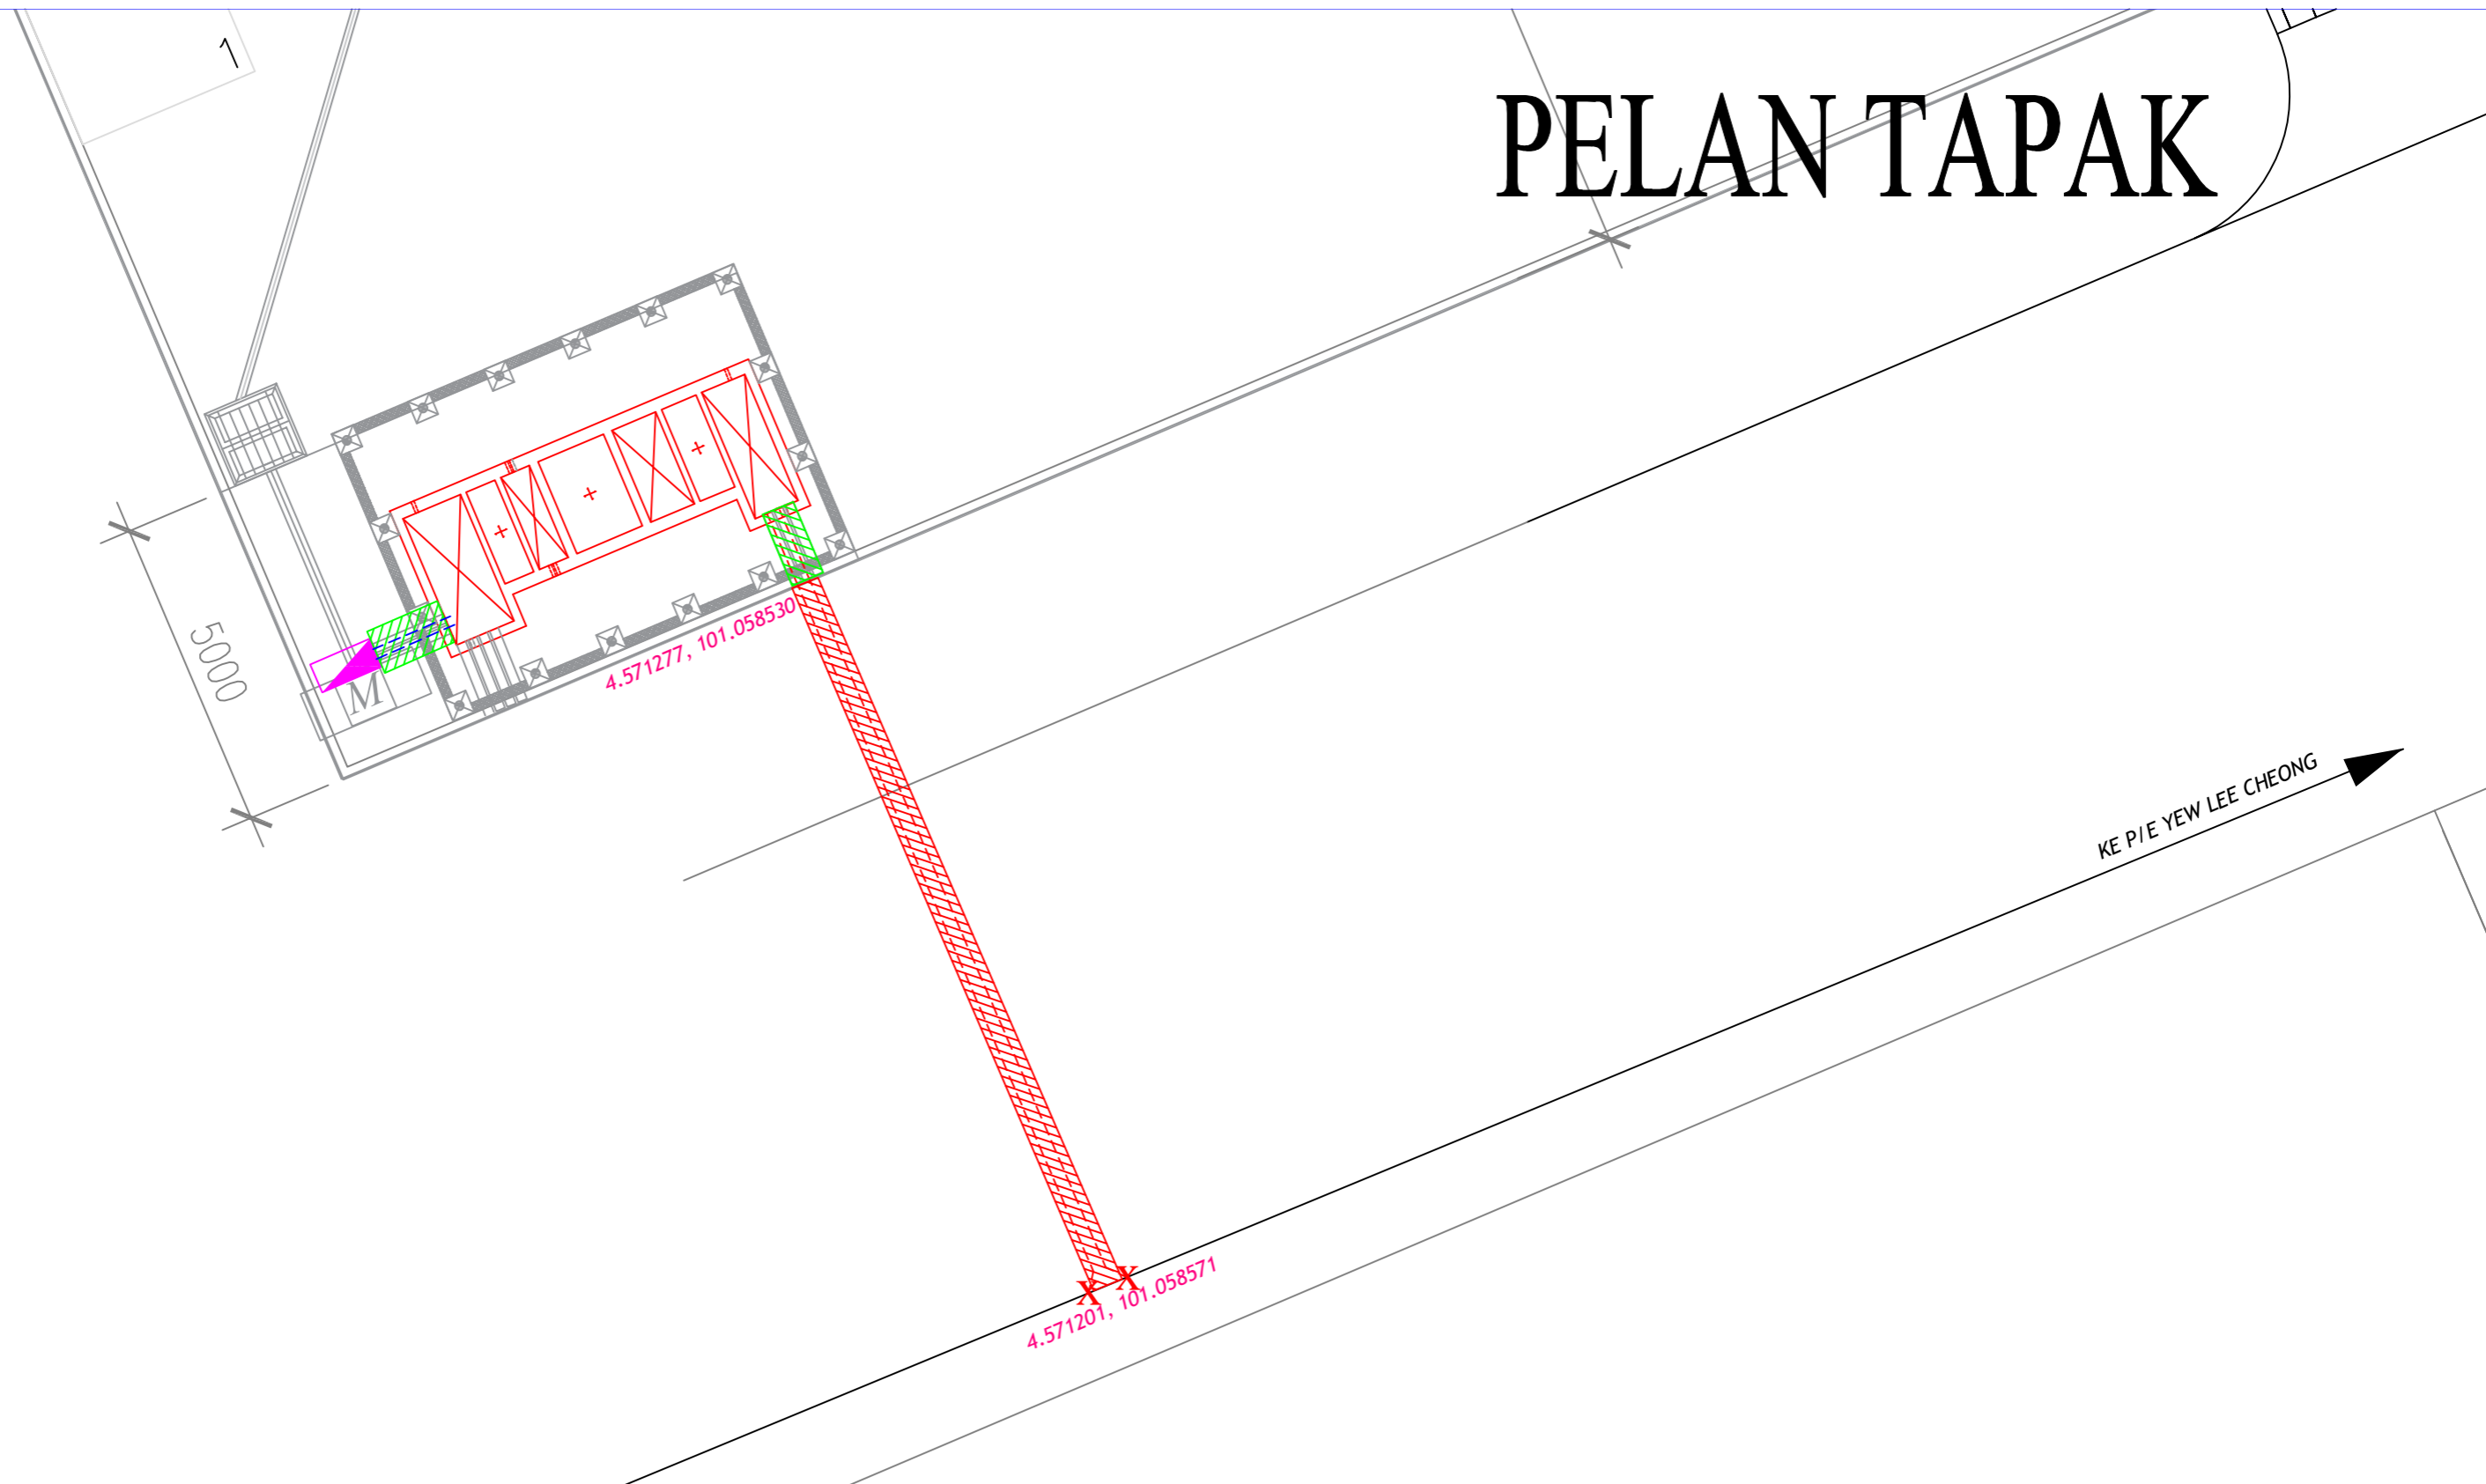

PELAN TAPAK



KE P/E SOON HIN HARDWARE

KE P/E YEW LEE CHEONG

- Cadangan**
-  Kabel B/Tanah KVT 150mmp x 3 teras XLPE alum (11kV)(22m)
 -  Kabel B/Tanah KVT 7x500mmp x 1 teras PVC/PVC Cu (1kV)
 -  Corrugated 150mmp(Atas Tar)
 -  Sambungan terus
- Petunjuk:**
-  Sediada
 -  Kabel B/Tanah KVT 185mmp x 3 teras xlpe alum (11kV)
 -  Meter Kiosk
 -  Paip PVC Class B



Kawasan	Daerah
No. Fail :	IPO 5440

PERMOHONAN BEKALAN ELEKTRIK KE CADANGAN MEMBINA SEBUAH KILANG KEJURUTERAAN BESI DI ATAS LOT 126749, HALA PERUSAHAAN MENGLEMBU 14, KAWASAN PERINDUSTRIAN MENGLEMBU, MUKIM HULU KINTA, DAERAH KINTA, IPOH, PERAK UNTUK TETUAN CCK ENGINEERING & TRADING SDN BHD (PEMAJU KEPADA EN. CHAN CHEE KONG)

ALL RIGHTS RESERVED
LUKISAN INI TIDAK BOLEH DIUBAHSUAI
TANPA KEBENARAN DARI JURUTERA
TENAGA NASIONAL BERHAD

Pindaan	Dilukis :	ALIAS	Diluluskan :	CIK NURUL
	Disemak :	SHUHALMI	Tarikh :	25.04.2024
	No. Lukisan :	C/IPOH/PTAPAK/IPO 5440		