


**KORIDOR
UTILITI**
DARUL RIDZUAN



LAPORAN CADANGAN TEKNIKAL



**TENAGA
NASIONAL** BERHAD

TAJUK PROJEK:

D-PZB-S24-3924 - MSVT PMU HTML KE PPU SABAK BERNAM.

NAMA SYARIKAT:

TENAGA NASIONAL BERHAD

LOKASI PROJEK:

Jln Klang – Teluk Intan (Route 5) & Jln Torkinton,
Hutan Melintang/Sabak Bernam.

1.1 MAKLUMAT PROJEK

Tajuk Projek	D-PZB-S24-3924 - MSVT PMU HTML KE PPU SABAK BERNAM.
Alamat Tapak Projek	Jln Klang – Teluk Intan (Route 5) & Jln Torkinton, Hutan Melintang/Sabak Bernam.
Pemilik Projek	TENAGA NASIONAL BERHAD
Koordinat Tapak Projek	3.886456°, 100.949714° - Point A 3.805725°, 100.996652° - Point B
Pihak Berkuasa Tempatan	
Pegawai Kontraktor Terlibat	
No. Tel Pegawai Kontraktor Terlibat	

1.2 PELAN LOKASI



MAKLUMAT LOKASI TAPAK PROJEK:

Nama Jalan	Jarak	Method
Jln Klang – Teluk Intan (Route 5) - Perak	11,097m	HDD
Jumlah	11,097m	

KOORDINAT MULA & AKHIR:

3.886456°, 100.949714° & 3.805725°, 100.996652°

KAEDAH KERJA:

HDD

1.3 LAPORAN GAMBAR LOKASI TAPAK PROJEK



Point A (kabel dari PMU Hutan Melintang) – Jln Klang Teluk Intan (Perak)
HDD
UG CABLE, 33kV, XLPE, AL, 1C, 630 mmp
HDPE PN10 sebanyak 3x150mmdia. +1x100mmdia.

11 Sep 2025 11:12:41
N 3° 52' 55.141", E 100° 57' 7.019"
Hutan Melintang, Perak 36400



JP02 – Jln Klang Teluk Intan (Perak)
HDD
UG CABLE, 33kV, XLPE, AL, 1C, 630 mmp
HDPE PN10 sebanyak 3x150mmdia. +1x100mmdia.

11 Sep 2025 11:13:49
N 3° 52' 42.865", E 100° 57' 13.525"
Hutan Melintang, Perak 36400




JP03 – Jln Klang Teluk Intan (Perak)

HDD

UG CABLE, 33kV, XLPE, AL, 1C, 630 mmp

HDPE PN10 sebanyak 3x150mmdia. +1x100mmdia.

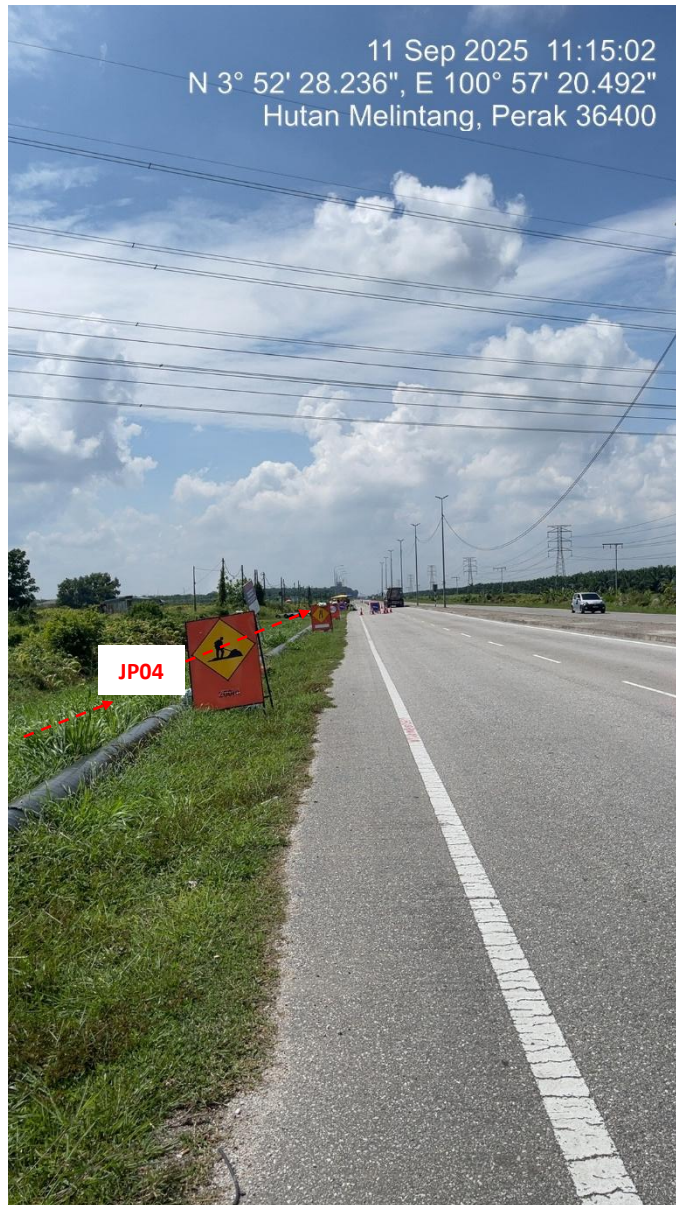

JP04 – Jln Klang Teluk Intan (Perak)
HDD
UG CABLE, 33kV, XLPE, AL, 1C, 630 mmp
HDPE PN10 sebanyak 3x150mmdia. +1x100mmdia.



JP05 – Jln Klang Teluk Intan (Perak)
HDD
UG CABLE, 33kV, XLPE, AL, 1C, 630 mmp
HDPE PN10 sebanyak 3x150mmdia. +1x100mmdia.



JP06 – Jln Klang Teluk Intan (Perak)
HDD
UG CABLE, 33kV, XLPE, AL, 1C, 630 mmp
HDPE PN10 sebanyak 3x150mmdia. +1x100mmdia.



JP07 – Jln Klang Teluk Intan (Perak)
HDD
UG CABLE, 33kV, XLPE, AL, 1C, 630 mmp
HDPE PN10 sebanyak 3x150mmdia. +1x100mmdia.



JP08 – Jln Klang Teluk Intan (Perak)
HDD
UG CABLE, 33kV, XLPE, AL, 1C, 630 mmp
HDPE PN10 sebanyak 3x150mmdia. +1x100mmdia.



JP09 – Jln Klang Teluk Intan (Perak)
HDD
UG CABLE, 33kV, XLPE, AL, 1C, 630 mmp
HDPE PN10 sebanyak 3x150mmdia. +1x100mmdia.



JP10 – Jln Klang Teluk Intan (Perak)
HDD
UG CABLE, 33kV, XLPE, AL, 1C, 630 mmp
HDPE PN10 sebanyak 3x150mmdia. +1x100mmdia.



JP11 – Jln Klang Teluk Intan (Perak)
HDD
UG CABLE, 33kV, XLPE, AL, 1C, 630 mmp
HDPE PN10 sebanyak 3x150mmdia. +1x100mmdia.



JP12 – Jln Klang Teluk Intan (Perak)
HDD
UG CABLE, 33kV, XLPE, AL, 1C, 630 mmp
HDPE PN10 sebanyak 3x150mmdia. +1x100mmdia.



JP13 – Jln Klang Teluk Intan (Perak)
HDD
UG CABLE, 33kV, XLPE, AL, 1C, 630 mmp
HDPE PN10 sebanyak 3x150mmdia. +1x100mmdia.



JP14 – Jln Klang Teluk Intan (Perak)
HDD
UG CABLE, 33kV, XLPE, AL, 1C, 630 mmp
HDPE PN10 sebanyak 3x150mmdia. +1x100mmdia.



JP15 – Jln Klang Teluk Intan (Perak)
HDD
UG CABLE, 33kV, XLPE, AL, 1C, 630 mmp
HDPE PN10 sebanyak 3x150mmdia. +1x100mmdia.



JP16 – Jln Klang Teluk Intan (Perak)
HDD
UG CABLE, 33kV, XLPE, AL, 1C, 630 mmp
HDPE PN10 sebanyak 3x150mmdia. +1x100mmdia.



JP17 – Jln Klang Teluk Intan (Perak)
HDD
UG CABLE, 33kV, XLPE, AL, 1C, 630 mmp
HDPE PN10 sebanyak 3x150mmdia. +1x100mmdia.



JP18 – Jln Klang Teluk Intan (Perak)
HDD
UG CABLE, 33kV, XLPE, AL, 1C, 630 mmp
HDPE PN10 sebanyak 3x150mmdia. +1x100mmdia.



JP19 – Jln Klang Teluk Intan (Perak)
HDD
UG CABLE, 33kV, XLPE, AL, 1C, 630 mmp
HDPE PN10 sebanyak 3x150mmdia. +1x100mmdia.



JP20 – Jln Klang Teluk Intan (Perak)
HDD
UG CABLE, 33kV, XLPE, AL, 1C, 630 mmp
HDPE PN10 sebanyak 3x150mmdia. +1x100mmdia.



JP21 – Jln Klang Teluk Intan (Perak)
HDD
UG CABLE, 33kV, XLPE, AL, 1C, 630 mmp
HDPE PN10 sebanyak 3x150mmdia. +1x100mmdia.



JP22 – Jln Klang Teluk Intan (Perak)
HDD
UG CABLE, 33kV, XLPE, AL, 1C, 630 mmp
HDPE PN10 sebanyak 3x150mmdia. +1x100mmdia.



JP23 – Jln Klang Teluk Intan (Perak)
HDD
UG CABLE, 33kV, XLPE, AL, 1C, 630 mmp
HDPE PN10 sebanyak 3x150mmdia. +1x100mmdia.



Point B (Kabel merentasi sungai ke Sabak Bernam) – Jln Klang Teluk Intan (Perak)
HDD
UG CABLE, 33kV, XLPE, AL, 1C, 630 mmp
HDPE PN10 sebanyak 3x150mmdia. +1x100mmdia.