

MSVT MENUKAR KABEL TALIAN ATAS VOLTAN TINGGI 11KV ABC BERSAIZ 70MMP KEPADA KABEL BAWAH TANAH XLPE 3C 240MMP DARI SS BUKIT TORAK KE PE SG. KUNING, TAIPING SEPANJANG 2850M



PENCAWANG ELEKTRIK SUIS BUKIT TORAK



CAD OPEN CUT



CAD OPEN CUT



CAD OPEN CUT




CAD HDD



CAD HDD



CAD HDD DAN OPEN CUT

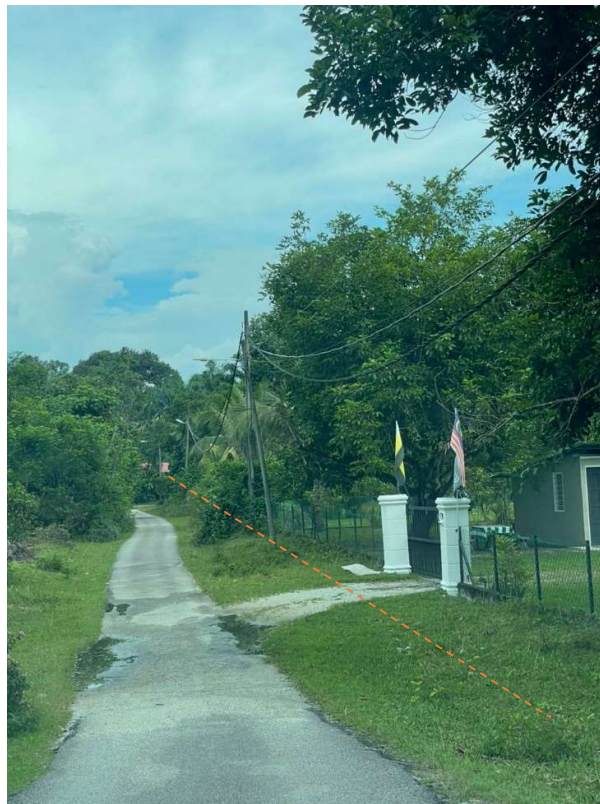

CAD OPEN CUT



CAD OPEN CUT



PENCAWANG ELEKTRIK SUNGAI KUNING.

