


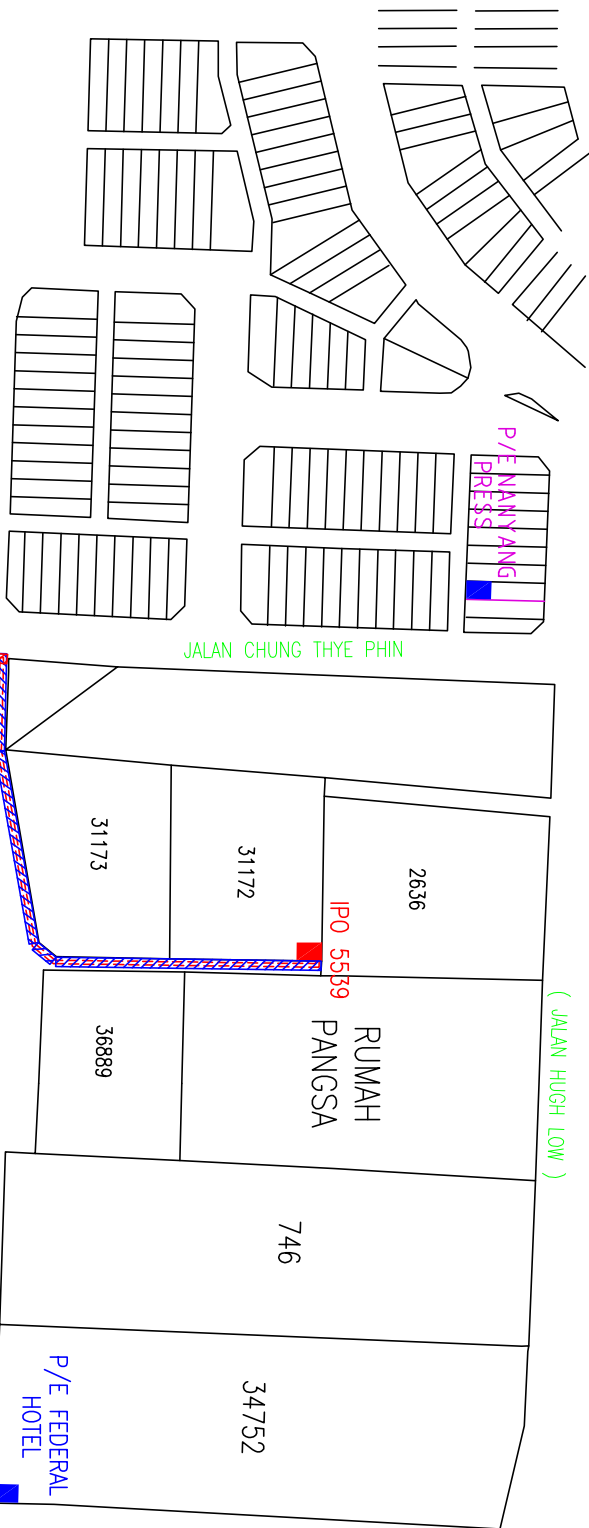

- Petunjuk:

Cadangan

Kabel B/Tanah KVT 240mmp x 3 teras xipe alum (11kV)

Paip Corrugated 150mmp - 2 Nos (open cut)

HDD Paip PN10 150mmp - 2 Nos (123m)

Potong & Sambung
- Petunjuk:
- Sedida

Kabel B/Tanah KVT 240mmp x 3 teras xipe alum (11kV)

TENAGA NASIONAL BERHAD

No. Fail :

IPO 5539

Daerah

Diluluskan :

TRAVIN

Tarikh :

16.07.2026

Diluluskan :

AKRIFUDIN

Tarikh :

16.07.2026

Diluluskan :

AKRIFUDIN

Tarikh :

16.07.2026

Diluluskan :

AKRIFUDIN

Tarikh :

16.07.2026

Diluluskan :

AKRIFUDIN

Tarikh :

16.07.2026

ALL RIGHTS RESERVED
DOKUMEN TEKNIK BOLEH DIKOPIR
TANPA MELAKSANAKAN PERSEKUTUAN
6704