



SUPPLY PLANNING 11KV & LV, SUBZONE TAIPING,
NETWORK PLANNING (PERAK), DISTRIBUTION NETWORK.


KAWASAN : PERAK	DAERAH : TAIPING
NO. FAIL :	SKIL : NTS
NO. PROJEK : D-TPG-S25-4550	

TAJUK :
MSVT MENUKAR KABEL TALIAN ATAS VOLTAN TINGGI
11KV ABC BERSAIZ 70MMP KEPADA KABEL BAWAH
TANAH XLPE 3C 240MMP DARI PE SG. DENDANG KE
PE FELCRA, TAIPING SEPANJANG 2.1KM

DILUKIS : HAFIZ	TARIKH : 24.10.2025
DISEMAK : HAFIZ	TARIKH : 24.10.2025
DILULUS : EN ZUBAIRI	TARIKH : 24.10.2025
NO. LUKISAN :D-TPG-S25-4550/TAPAK	

PETUNJUK:-

- TANAH BIASA
- HDD
- KABEL SEDIADA
- ▨ HDPE PIPE JALAN BERTAR
- /// RENTANG DI JALAN BERTAR

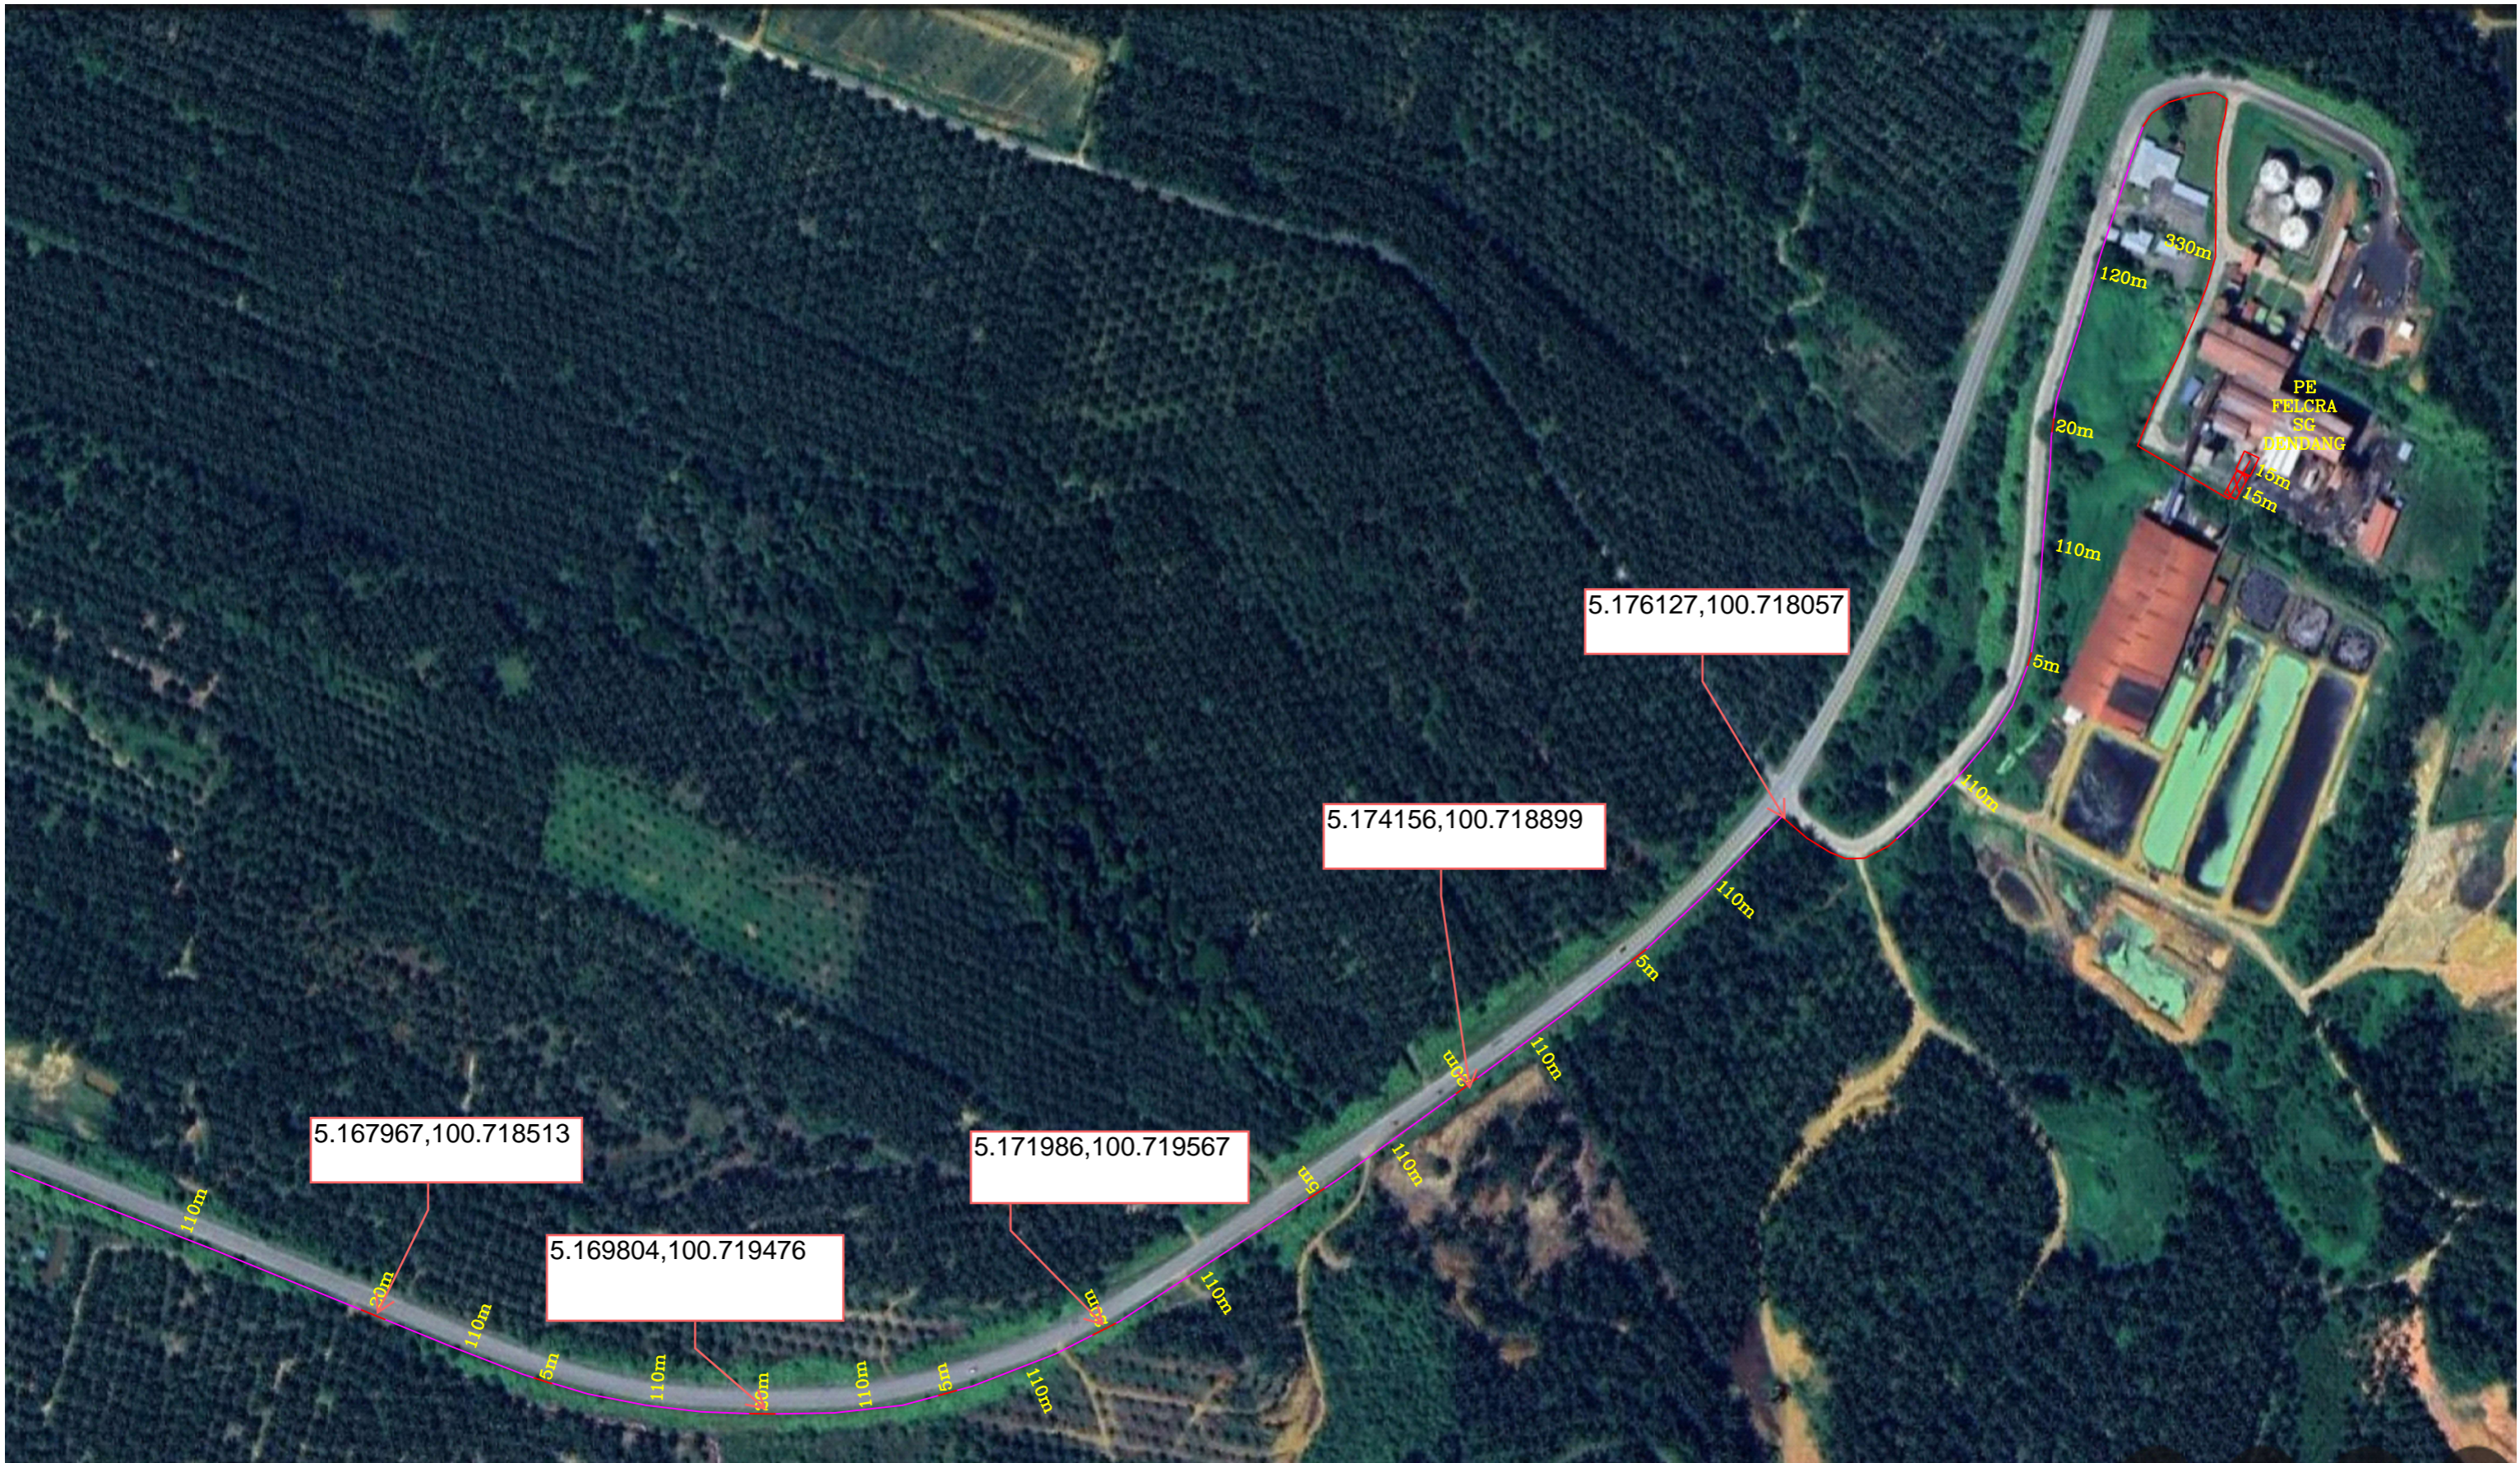

5.167967,100.718513

5.169804,100.719476

5.171986,100.719567

5.174156,100.718899

5.176127,100.718057



SUPPLY PLANNING 11KV & LV, SUBZONE TAIPING, NETWORK PLANNING (PERAK), DISTRIBUTION NETWORK.

KAWASAN : PERAK DAERAH : TAIPING

NO. FAIL : SKIL : NTS

NO. PROJEK : D-TPG-S25-4550

TAJUK : MSVT MENUKAR KABEL TALIAN ATAS VOLTAN TINGGI 11KV ABC BERSAIZ 70MMP KEPADA KABEL BAWAH TANAH XLPE 3C 240MMP DARI PE SG. DENDANG KE PE FELCRA, TAIPING SEPANJANG 2.1KM

DILUKIS : HAFIZ TARIKH : 24.10.2025

DISEMAK : HAFIZ TARIKH : 24.10.2025

DILULUS : EN ZUBAIRI TARIKH : 24.10.2025

NO. LUKISAN :D-TPG-S25-4550/TAPAK

- PETUNJUK:-
- TANAH BIASA
 - HDD
 - KABEL SEDIADA
 - ▨ HDPE PIPE JALAN BERTAR
 - /// RENTANG DI JALAN BERTAR