


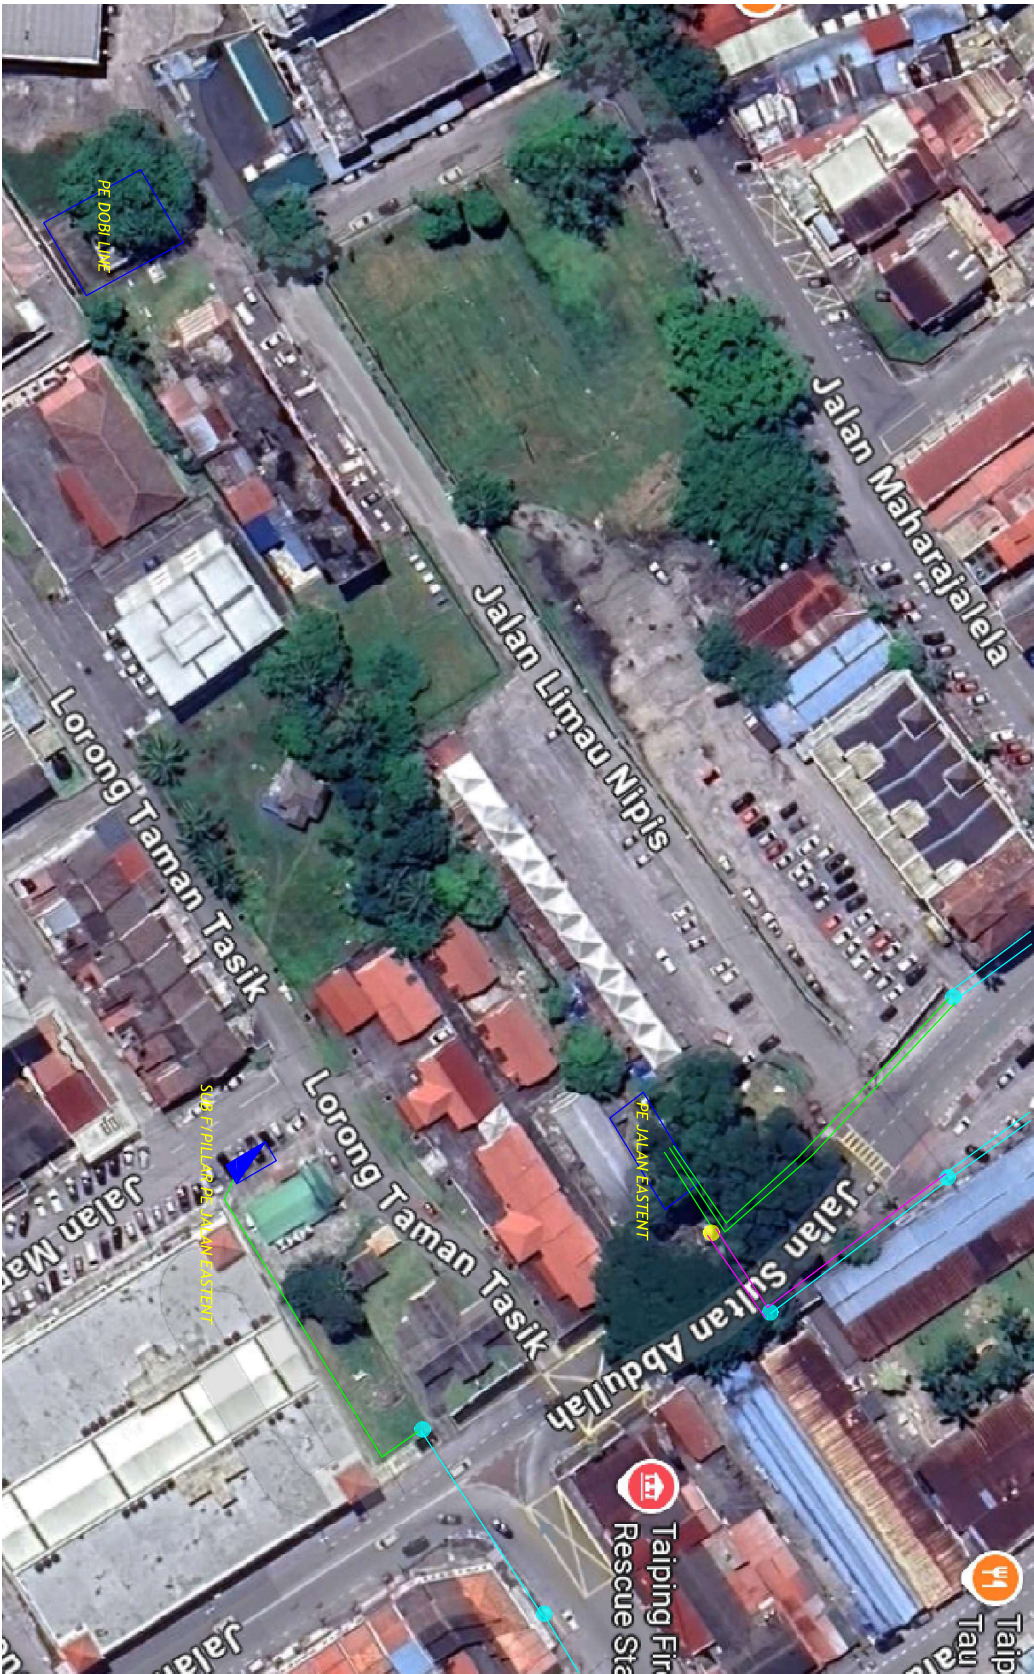

Petunjuk: (Sedia ada)

Talian Sedia ada

Tiang konkrit 9.0m

Peti Pembekal 1600A

Petunjuk: (Cadangan)

Tiang

Kabel UG 185mm²

Talian 3X185mm²-120mm²-16mm²



TENAGA NASIONAL BERHAD

Kawasan No RLO Daerah

Pindaan

Diluluskan : ZULHANNIZ
Disenarai :
No. Luluskan : Tarikh :

ALL RIGHTS RESERVED
TAIPING FIRE RESCUE STATION
TAIPING NASIONAL BERHAD