
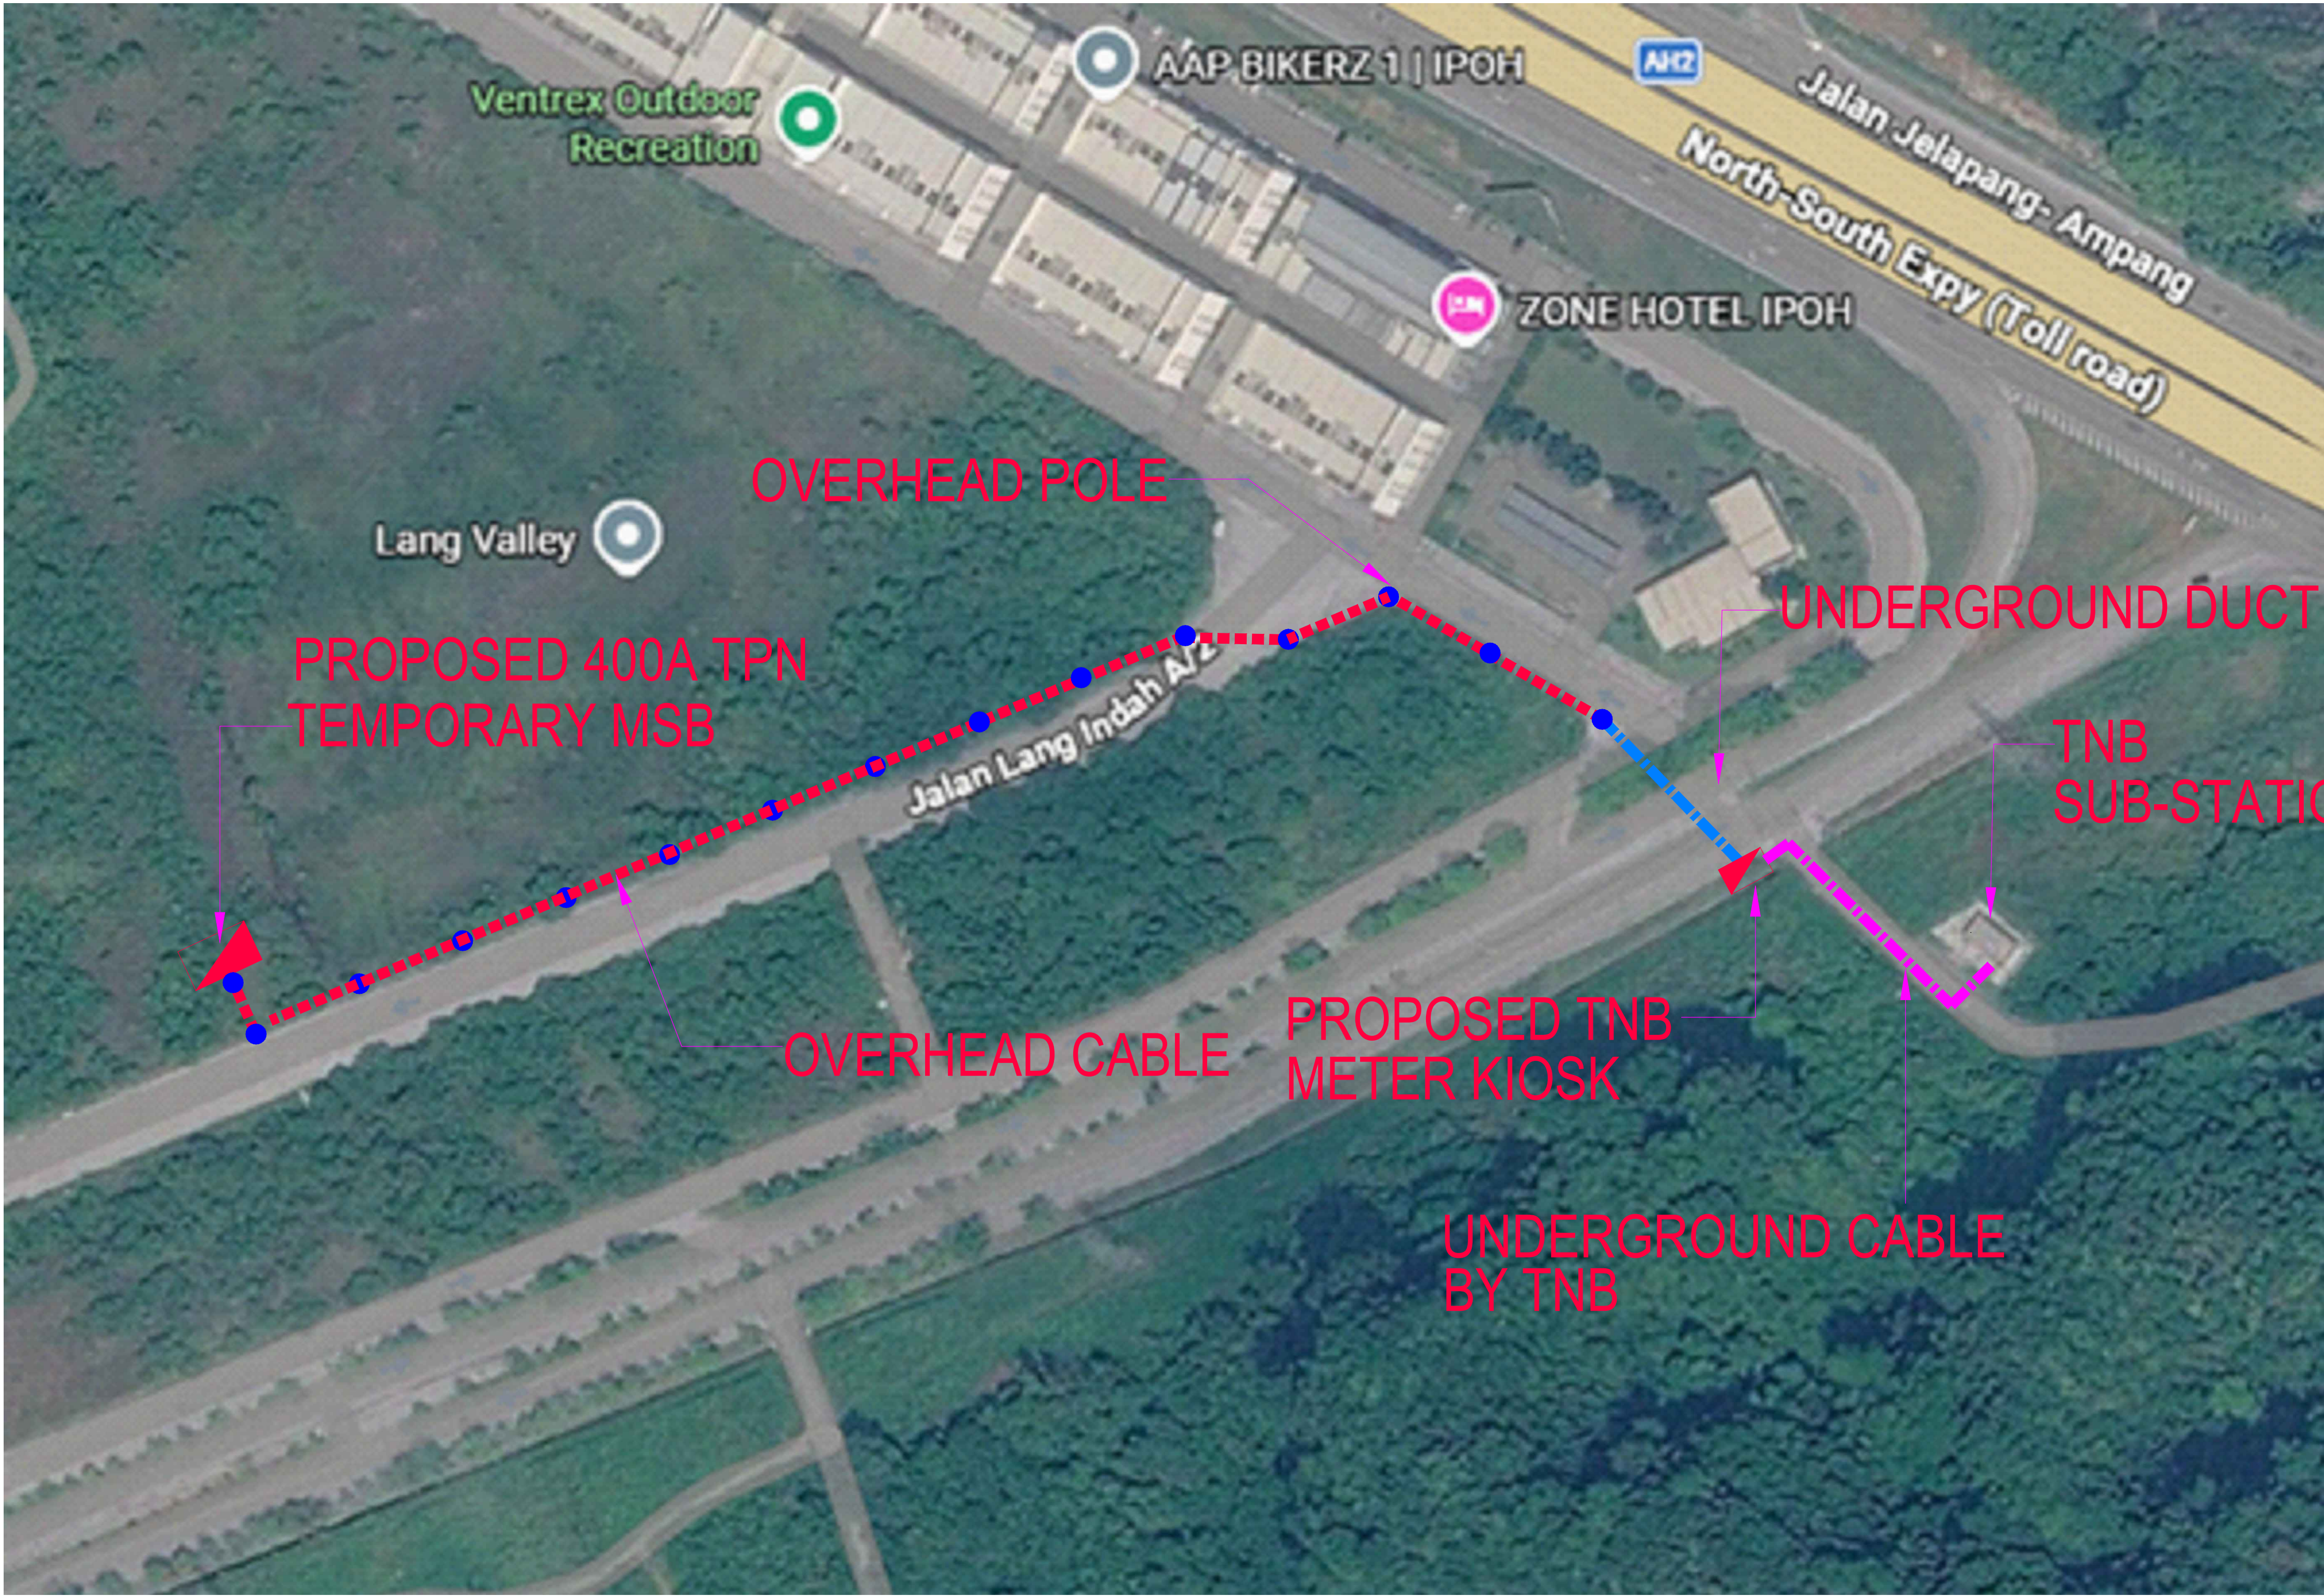
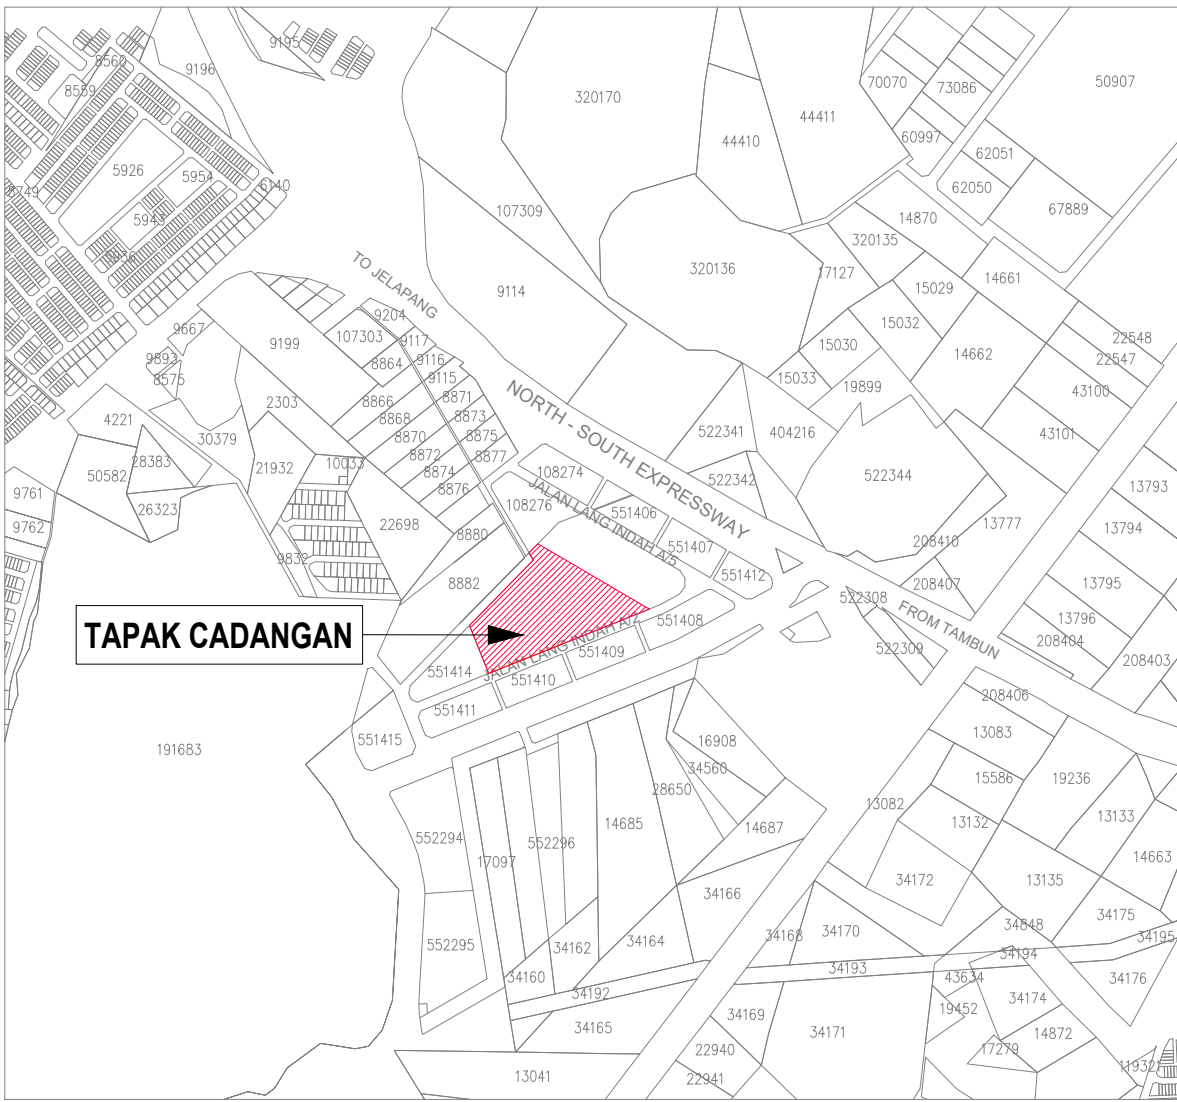
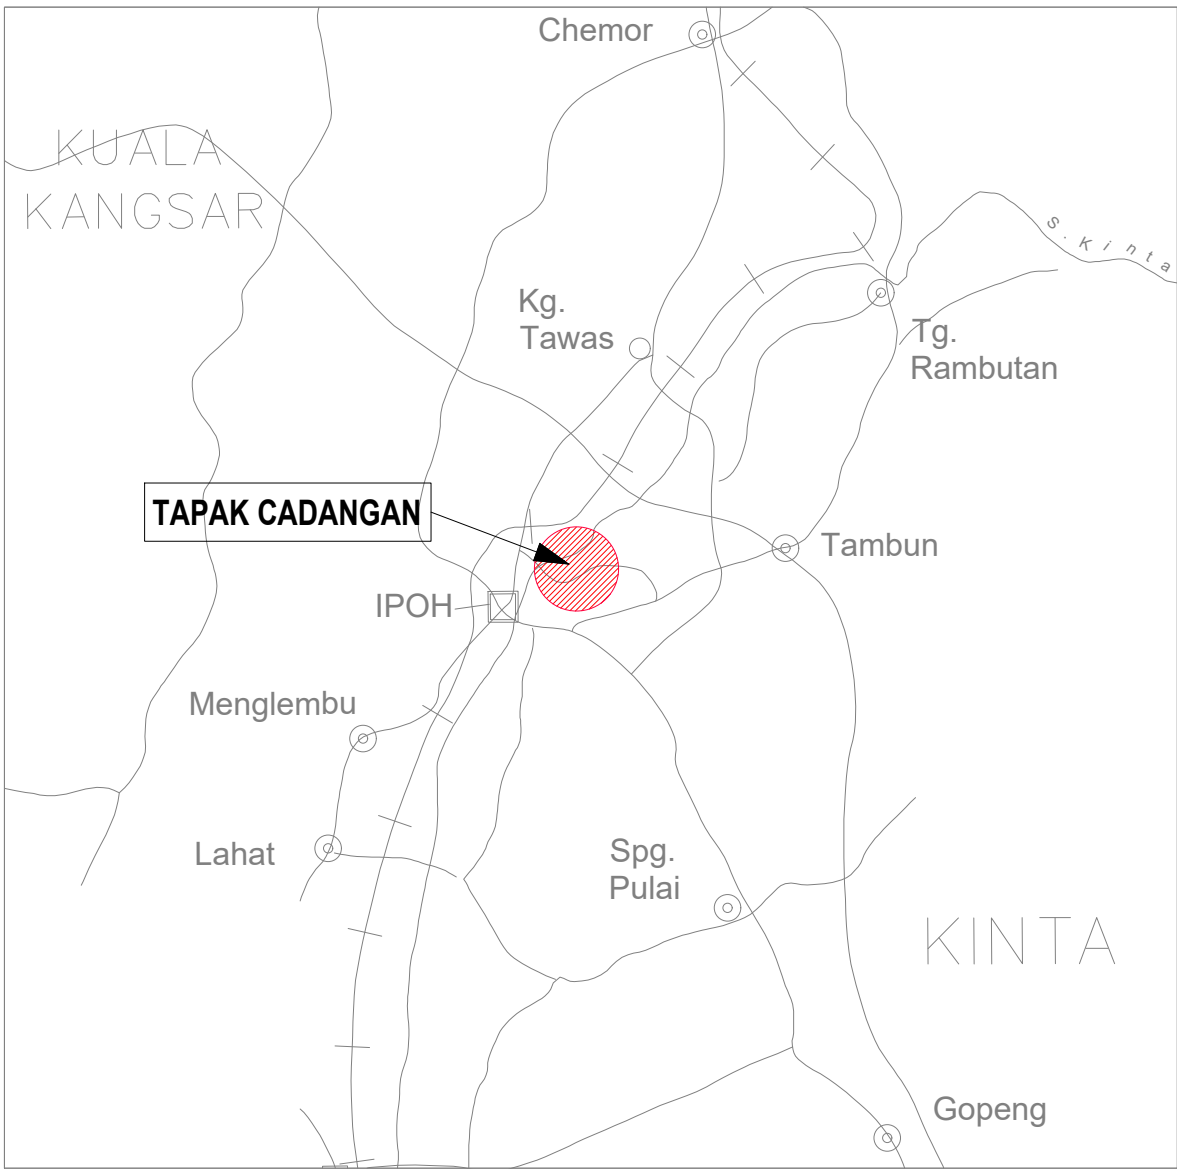




owner		
MASUKA BINA SDN. BHD. NO. 163E-19-01 & 20-01, HUNZA TOWER, KELAWAI ROAD, 10250 PENANG.		
consultant engineer		
Perunding Jurutera C S N MECHANICAL & ELECTRICAL CONSULTING ENGINEERS 70-03-17 D'Piazza Mall, Jalan Mahsuri, 11950 Bayan Lepas, Pulau Pinang. Tel. No : 04- 646 3008 Fax No : 04- 643 2007 csn.perunding.ng@gmail.com		
electrical contractor		
 Grouplite Engineering Sendirian Berhad No. 98, Jalan Tanjung Tokong, 10470 Penang. TEL : 04-8901178 FAX : 04-8901811 E-mail : info@grouplite.net		
project		
PROPOSED 400A TPN TEMPORARY SUPPLY ON PART OF LOT PT 286720 (HSD 938010), PT286721(HSD 938011) & PT 286722 (HSD 938012) IN MUKIM HULU KINTA, HULU KINTA DISTRICT, PERAK DARUL RIDZUAN GPS COORDINATE : 4.628479, 101.094398		
services		
ELECTRICAL INSTALLATION		
title		
SITE, LOCATION AND KEY PLAN		
drawing no.		
CSN/26/253/TEMP/SITE/01		
scale :	N.T.S.	Rev. No.
drawn by :	OLT	
designed by :		sheet no.
checked by :	T.K.CH'NG	
approved by :		
autocad file no :		